


MUX CODE

CHANNEL SW HEX

1	F
2	7
3	B
4	3
5	D
6	5
7	9
8	1
9	E
10	6
11	A
12	2
13	C
14	4
15	8
16	0


500K RESISTOR
BETWEEN CHASSIS GND
AND EACH CHANNEL
ADJUST P1/P2
FOR 6.00 V
ANALOG OUT

300 mA DRAW

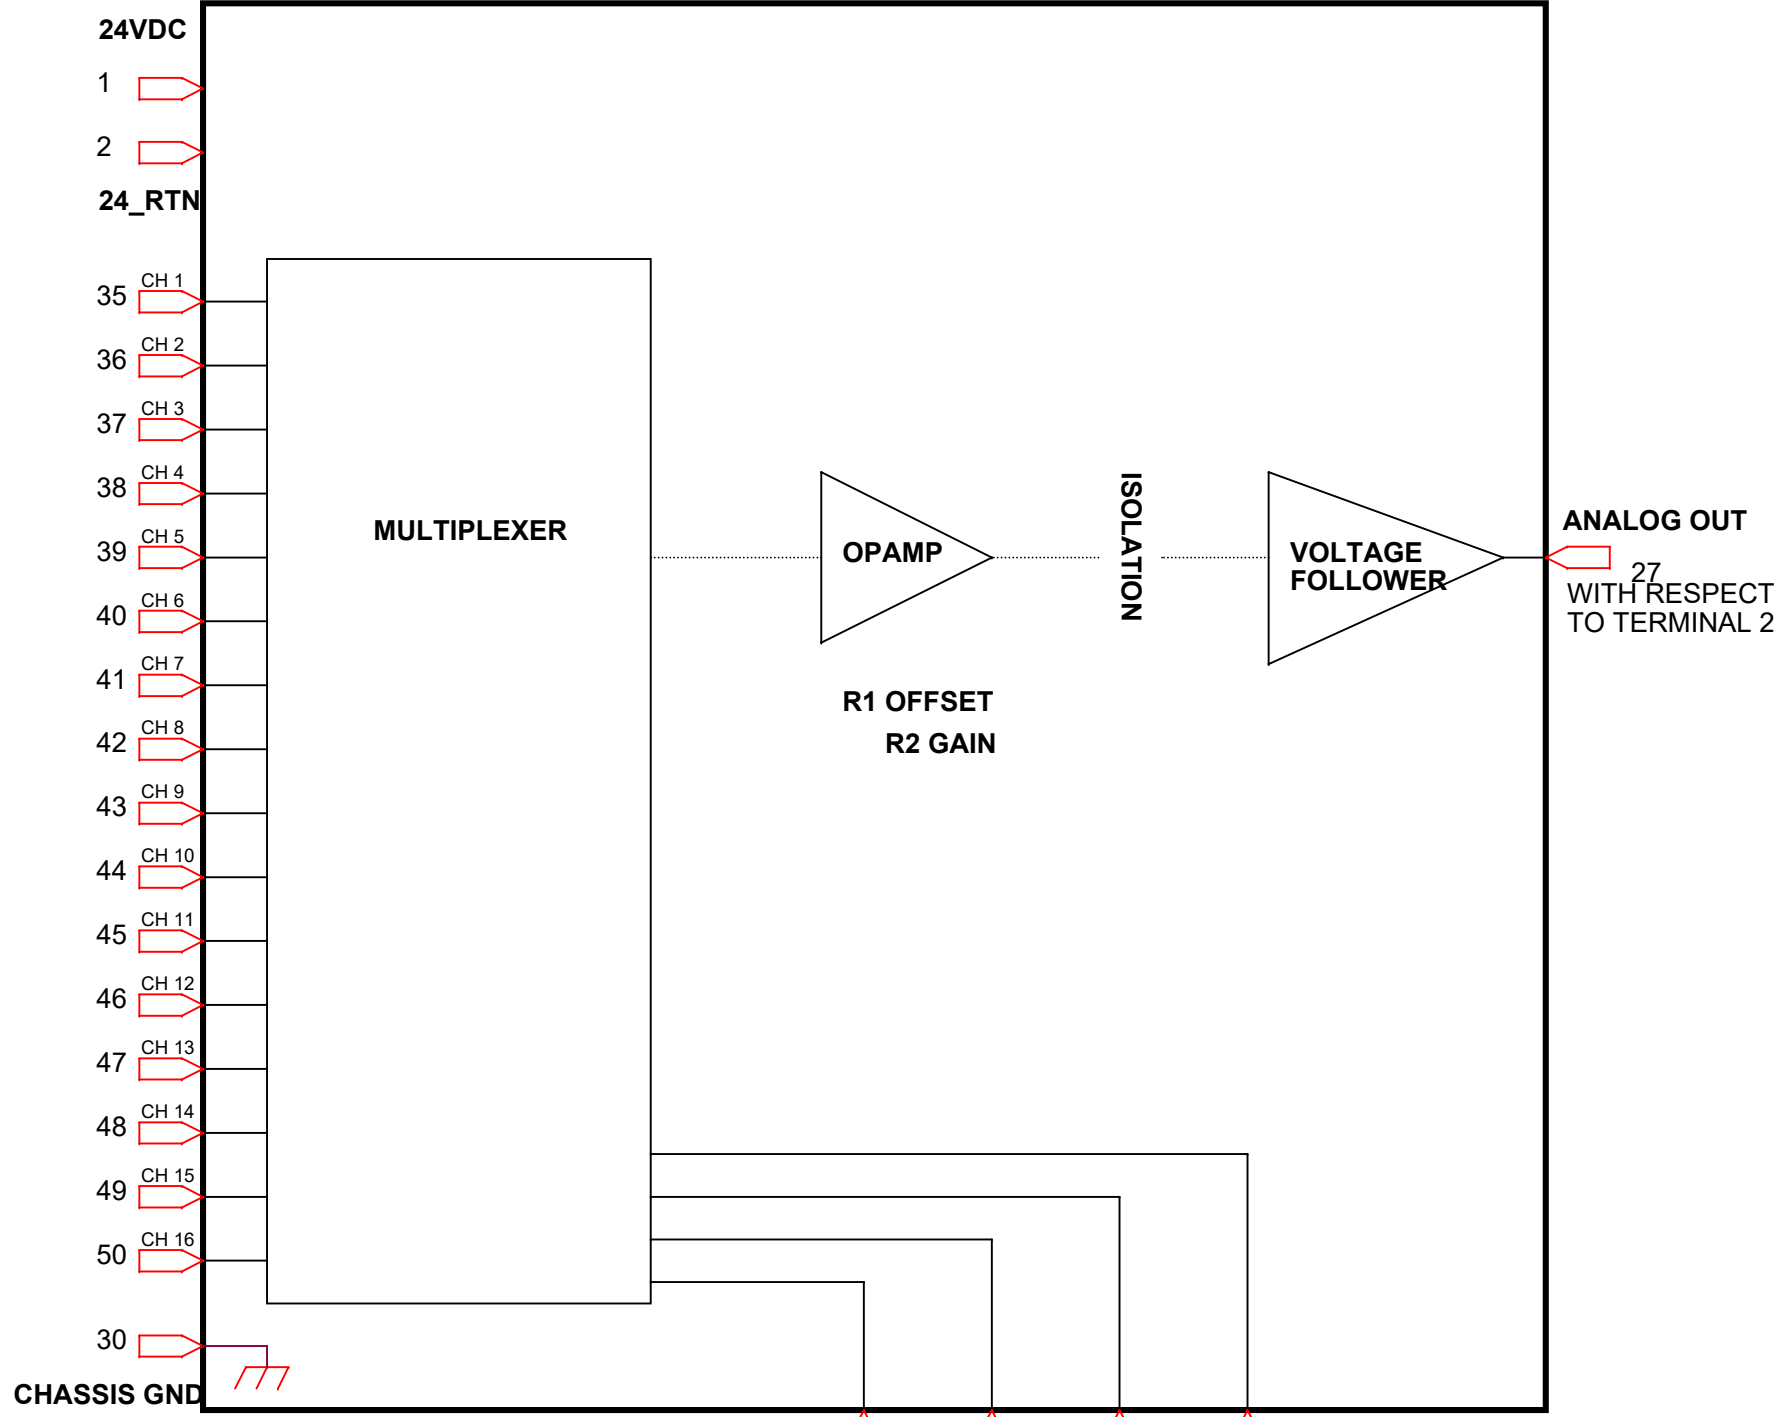


+15V

CONNECT TO C18 POSITIVE
(NEAREST TERMINAL 1)

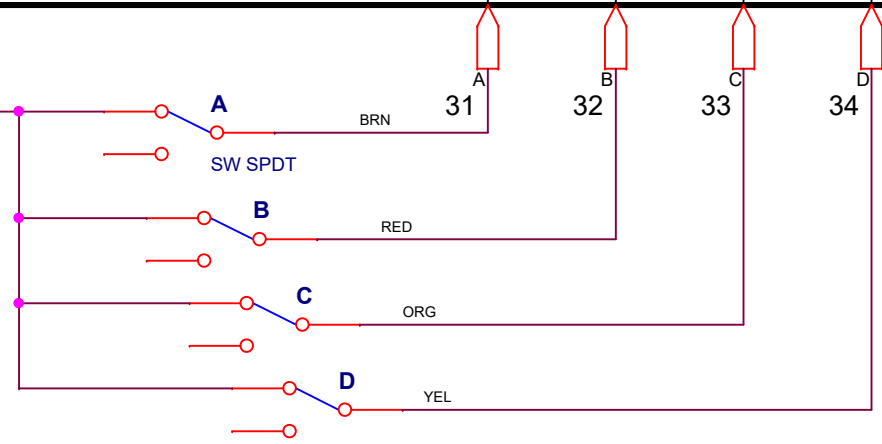

Title		
Test Jig, Sense Lines, Ventana Ground Fault Board		
Size	Document Number	Rev
B	<Doc>	A
Date:	Friday, September 07, 2018	Sheet 1 of 1

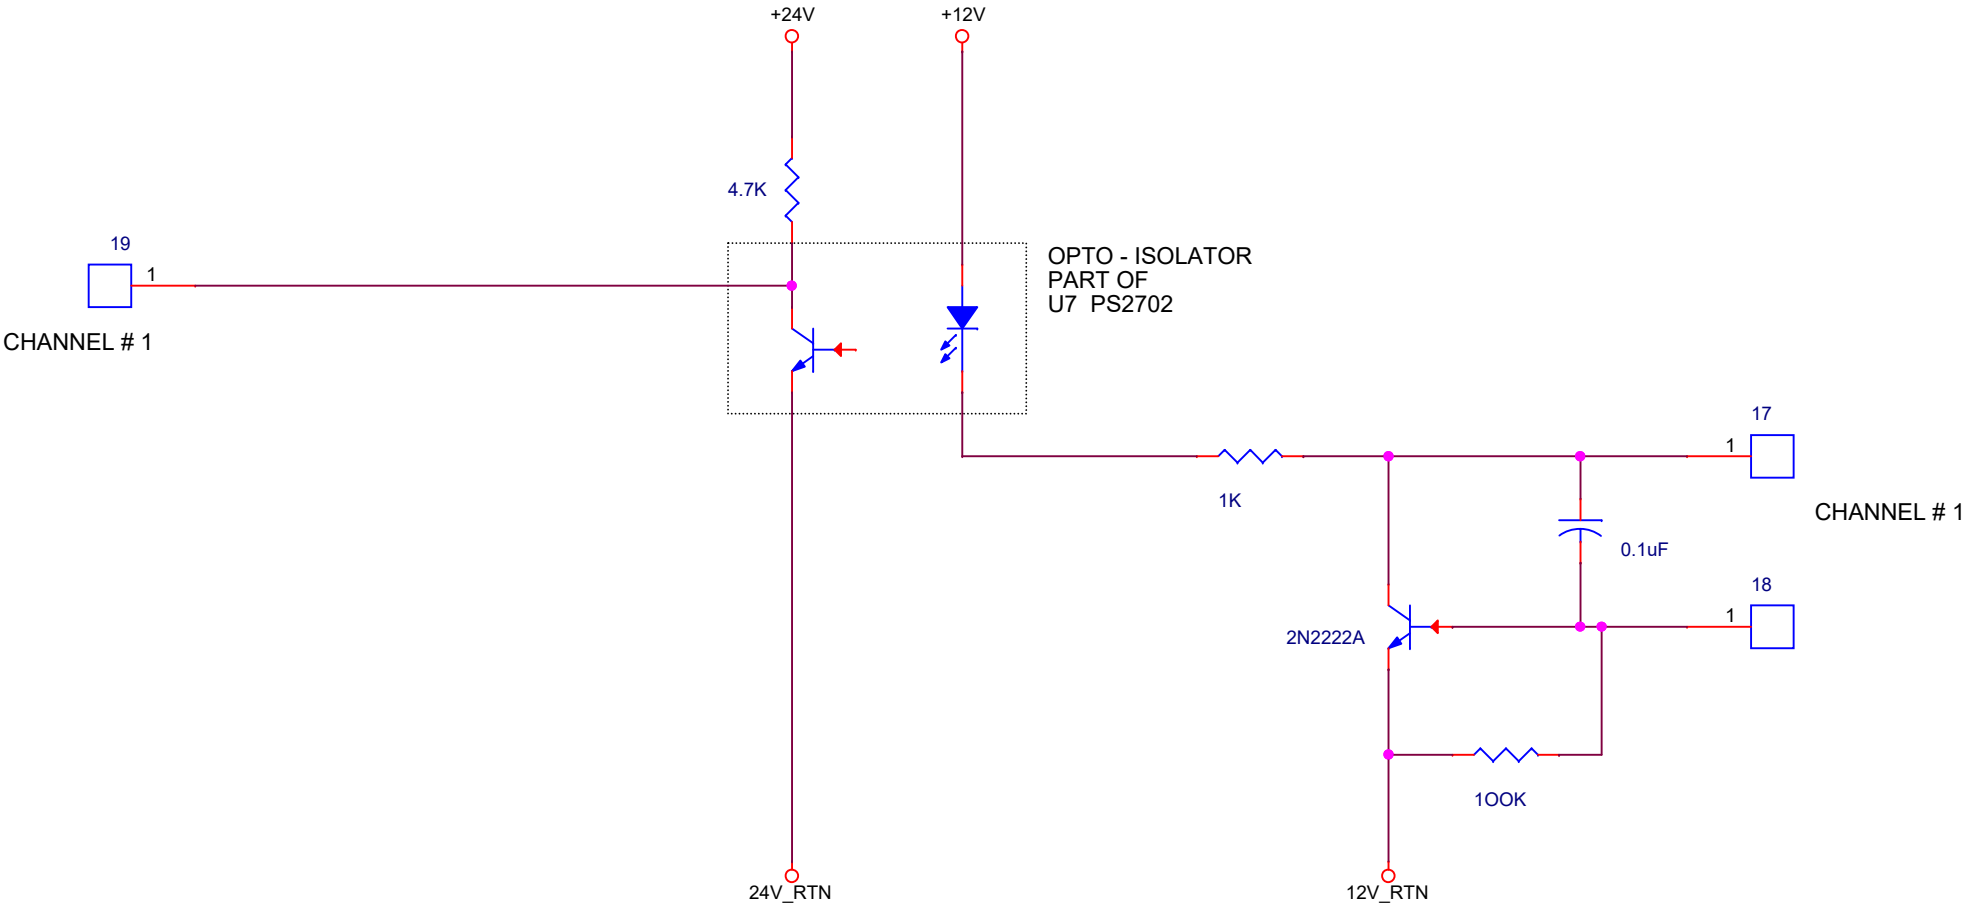

Title		
Single Channel Water Sensing		
Size	Document Number	Rev
B	<Doc>	A
Date:	Friday, September 07, 2018	Sheet 1 of 1