




Generator specs TBD
Voltage: 36-42V
Current: No more than 100A

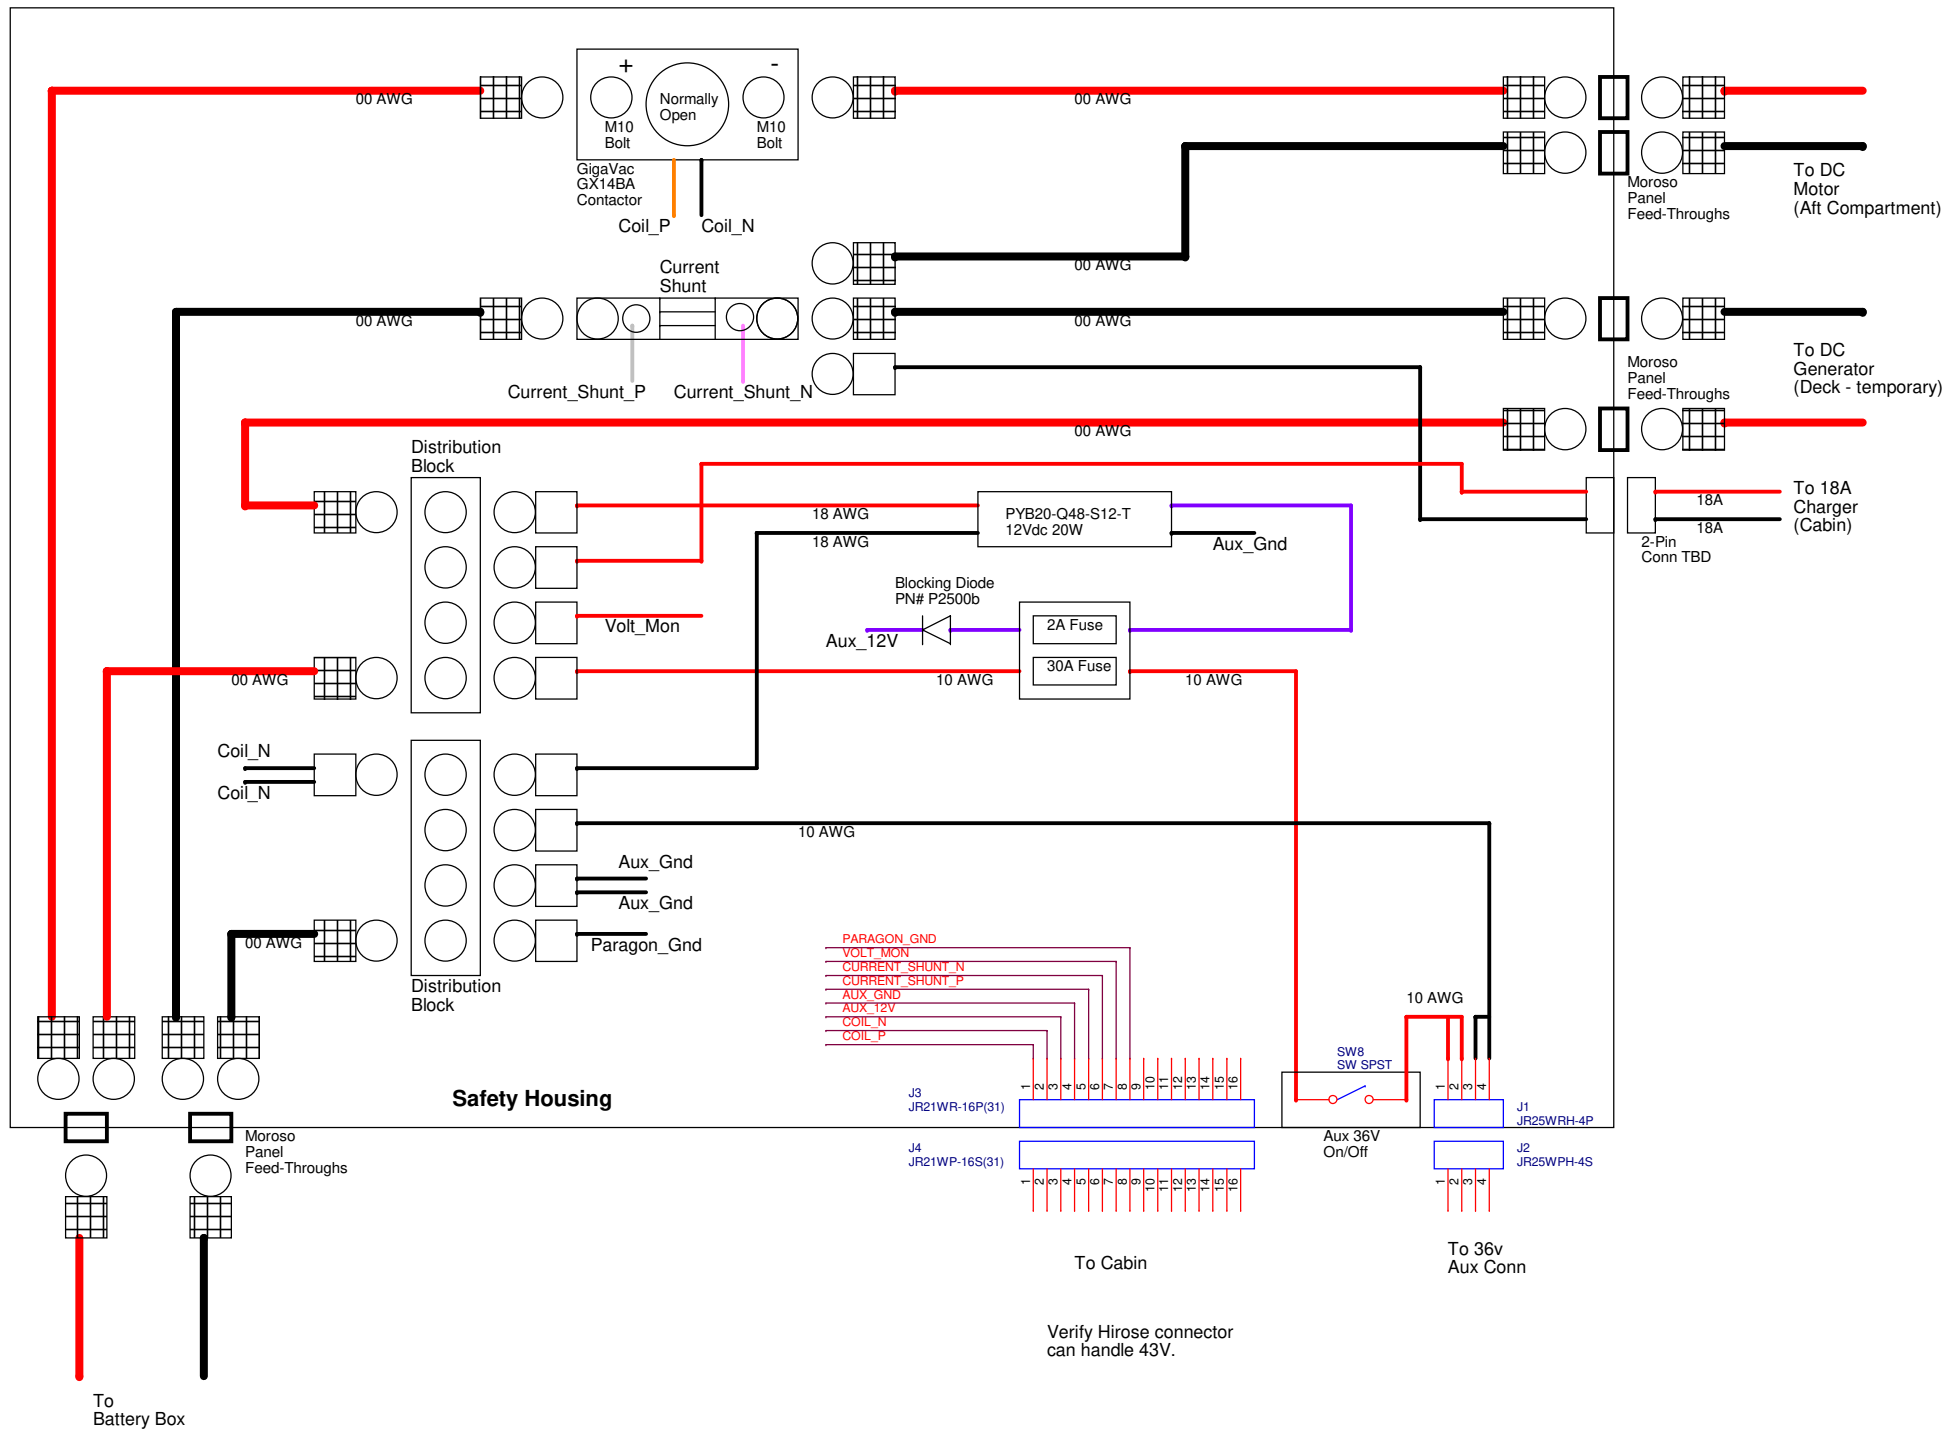

Schematic Name: Post Review Drawings					
Page Title: Safety Housing			Engineer: <Engineer>		
Project Name: <Project Name>			Designer: <Designer>		
Group Name: <System>		System: <Subsystem>		Last Updated By: <Updated By>	
Drawing Number: MBARI DN		Release: <Rev>		Version: <Version>	
Page Modify Date: Tuesday, May 11, 2022		Check In Date: <LCID>		Status: <Status>	
Sheet		Page Number		Page Count	