


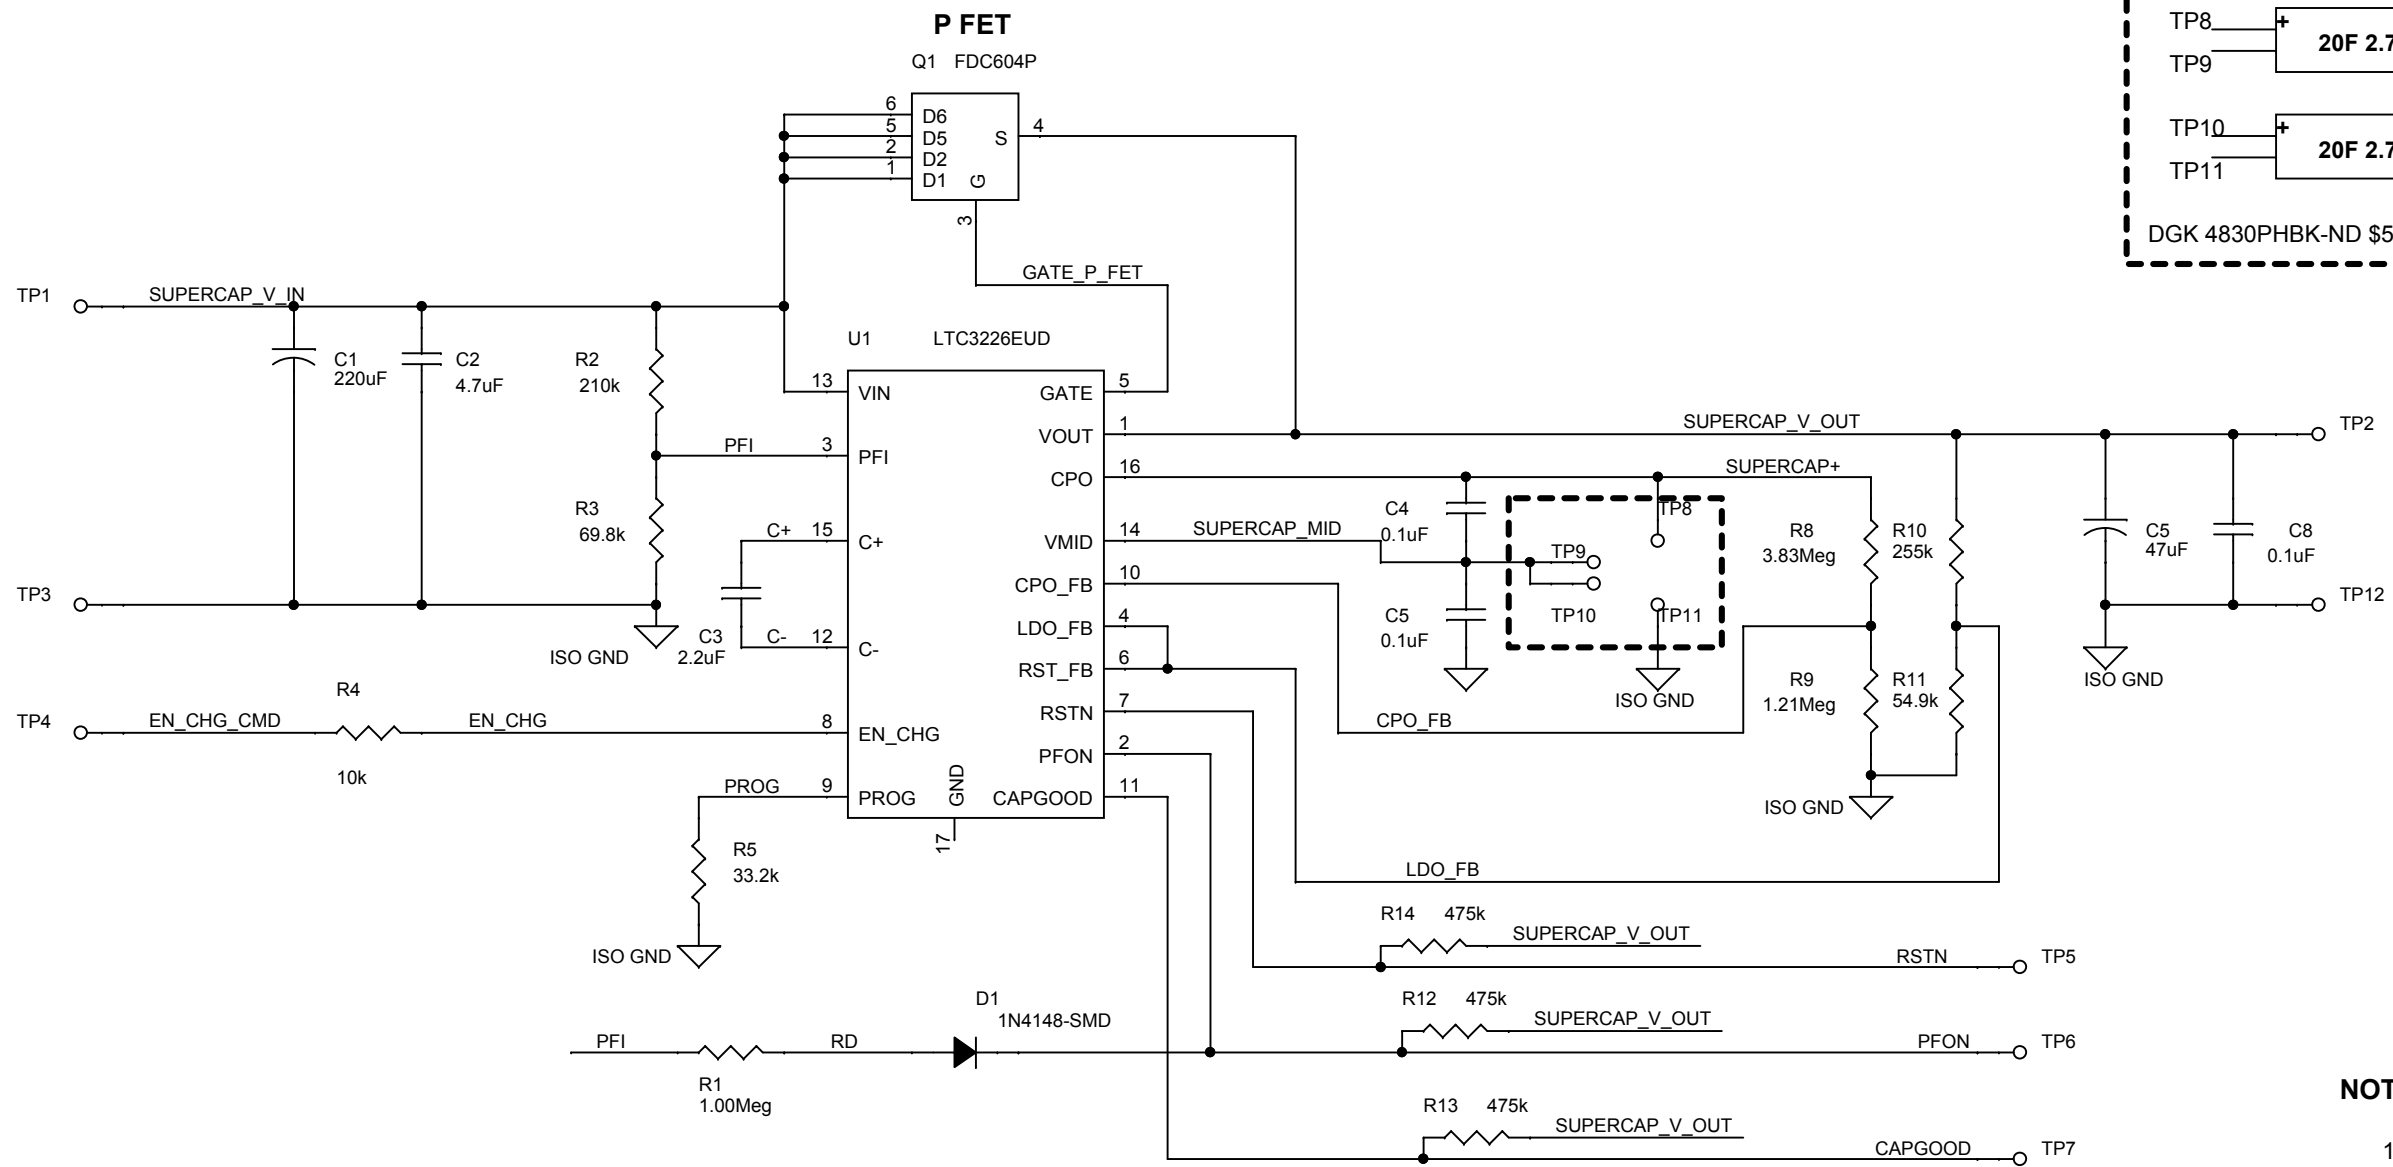

SUPER CAPS

TP8+
TP9-20F 2.7V

TP10+
TP11-20F 2.7V

DGK 4830PHBK-ND \$5.09 Ea

- NOTES:
1. Power Fail In Set By R1 - R2 divider
4.81V R2 = 210k R3 = 69.8k
 2. SuperCap Termination Voltage
Set by R3 - R5 divider
4.998V R8 = 3.83 Meg R9 = 1.21 Meg
 3. LDO Output Voltage (Vout)
Set by R4 - R6 divider
4.34V R10 = 255k R11 = 57.6k

Title		
SCH, SUPERCAP TEST PROTO		
Size	Document Number	Rev
B	10020068	A
Date:	Tuesday, February 07, 2017	Sheet 1 of 1