




Rev Notes

- | | | |
|--|-----------|-----|
| 1) Add Water Sensors; re-arrange for clarity. | 14 Mar 05 | ECM |
| 2) Enlarge fonts for GUI | 24 Mar 05 | ECM |
| 3) Show 48-12 redundancy details; update Load Cell channels; new ADC24 and ADC29 Temperature locations | 27 Jun 06 | ECM |

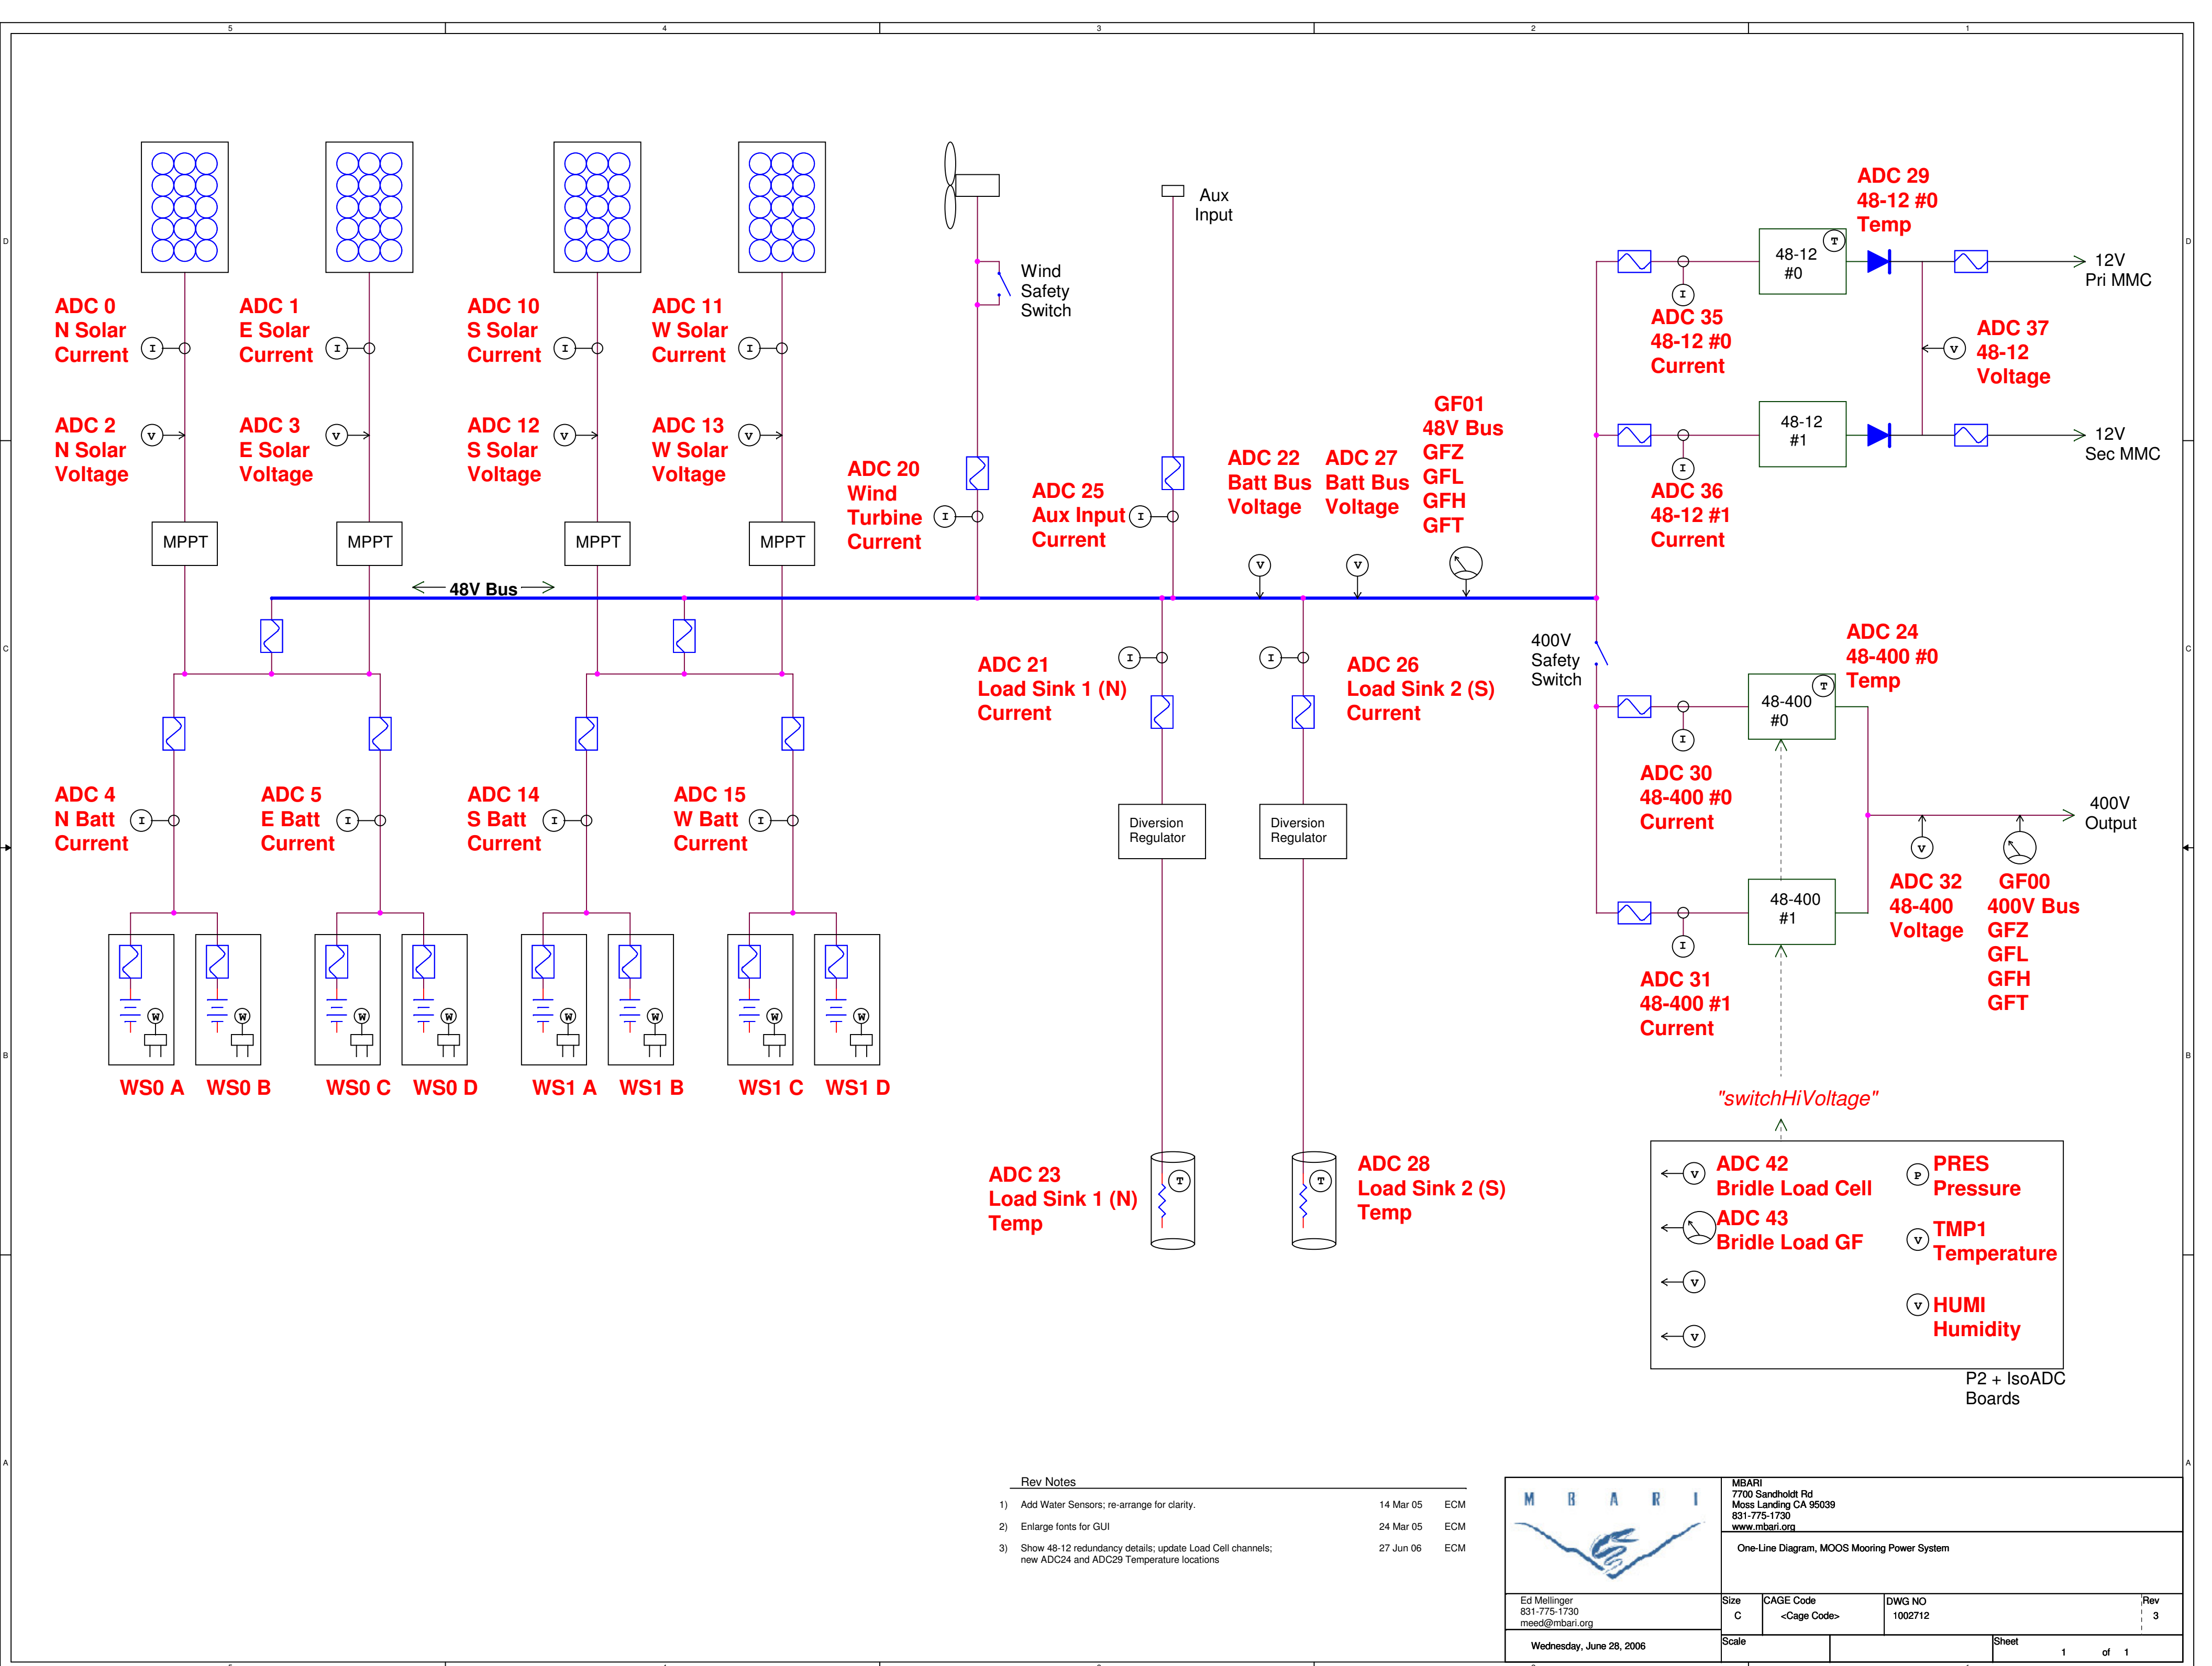

MBARI 7700 Sandholdt Rd Moss Landing CA 95039 831-775-1730 www.mbari.org			
One-Line Diagram, MOOS Mooring Power System			
Ed Mellinger 831-775-1730 meed@mbari.org	Size C	CAGE Code <Cage Code>	DWG NO 1002712
Wednesday, June 28, 2006	Scale	Sheet 1	Rev 3