


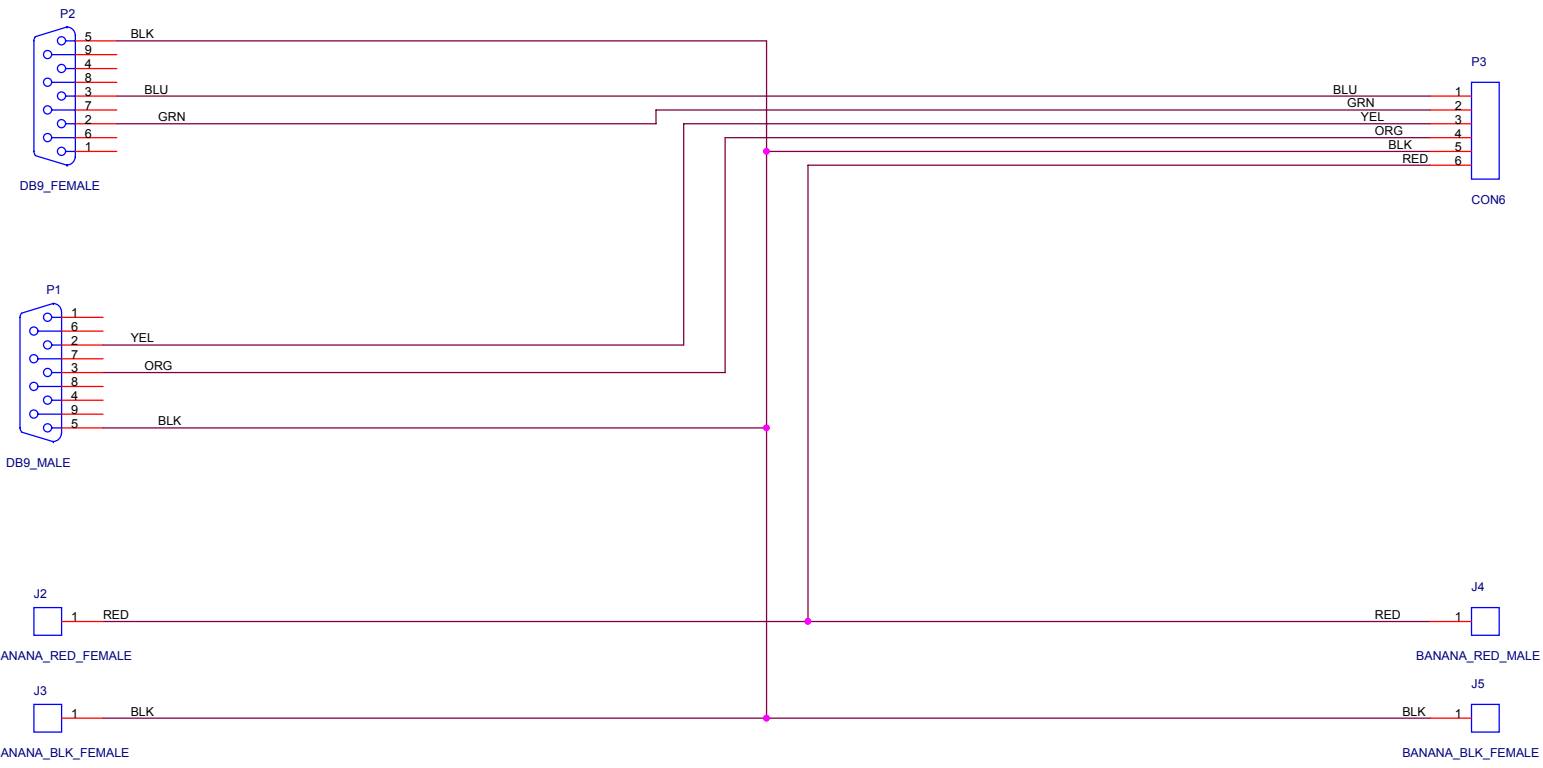

- NOTES (Unless otherwise noted):
1. 22 AWG STRANDED WIRE
 2. INSTALL HEAT SHRINK TUBING ON ALL SOLDER CONNECTIONS
 3. INSTALL PLASTIC SHELLS ON DB9 CONNECTORS

Title		
PUCK TEST CABLE		
Size	Document Number	Rev
B	<Doc>	A
Date:	Tuesday, May 10, 2005	Sheet 1 of 1