


REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

- NOTE:
1. All resistors are 1%, 1/4 W unless otherwise specified.
 2. For modules to be used in 48V supply, do not install U4, LT1011.
 3. To select Q1 - Q7, install zero ohm, 0805 resistor as required.

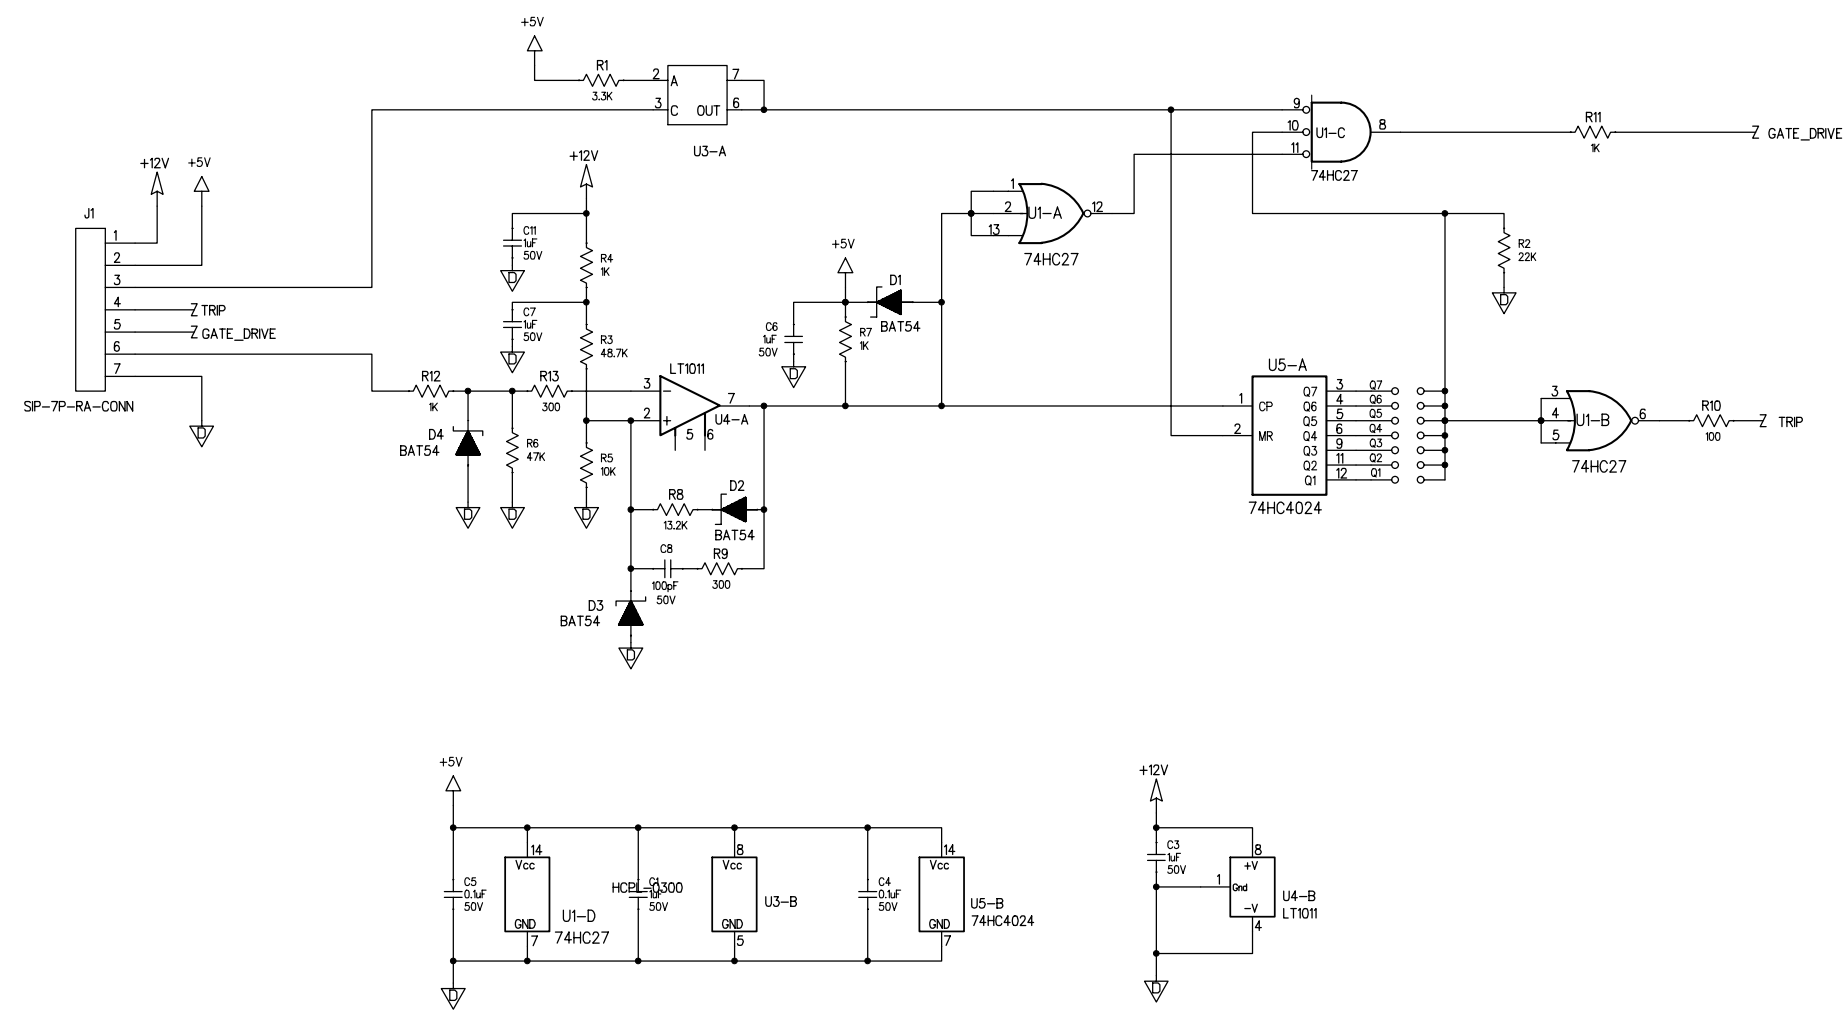

PRELIMINARY

APPLIED PHYSICS LABORATORY		APPLIED PHYSICS LABORATORY	
CONTRACT NO.		UNIVERSITY OF WASHINGTON	
PI	B. HOWE	APB SEATTLE WASHINGTON TITLE: Load Control Circuit Breaker Schematic MARS Low Voltage System	
SYS ENGR	T. MCGINNIS		
ENGINEER			
CHECKED:	S. KOLVE		
DRAWN:	R.G. MILLS		
APPLICATION DATA		REV:	CODE:
NEXT ASSY.	USED ON	A	98514
		DATE:	17 October 2004
		DRAWING NO:	
		53867	
		Sheet 1 of 1	