


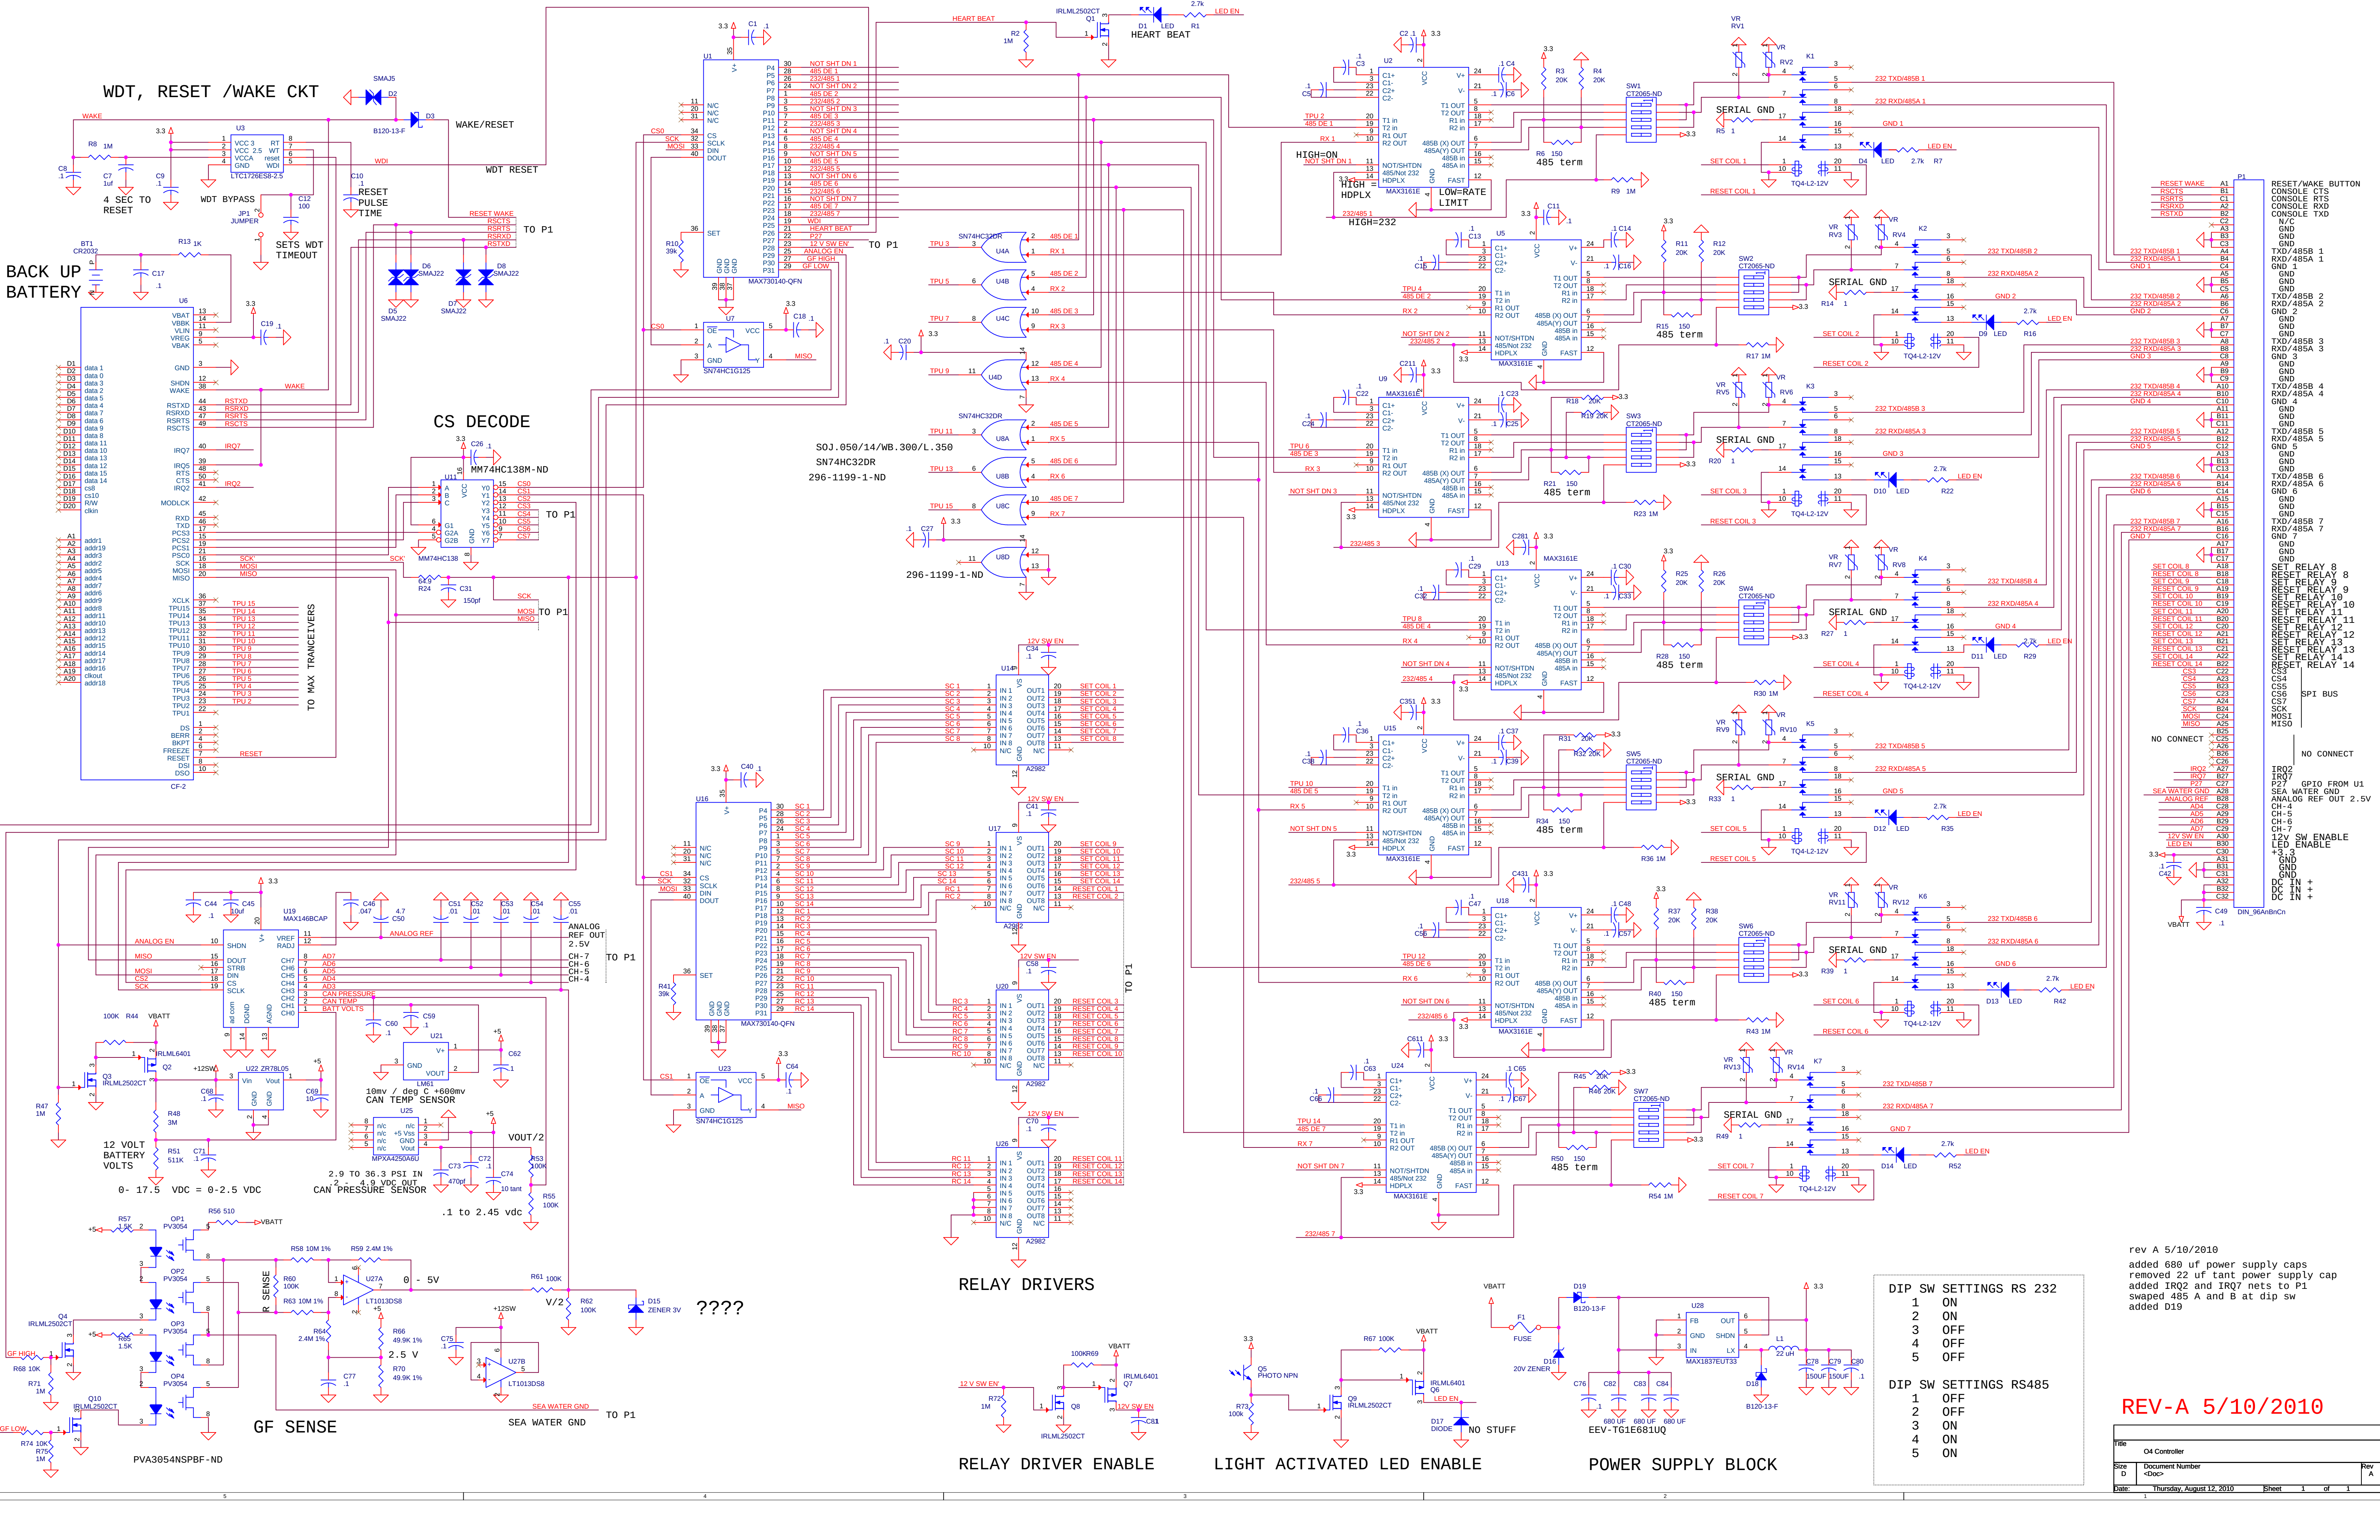

rev A 5/10/2010
added 680 uf power supply caps
removed 22 uf tant power supply cap
added IRQ2 and IRQ7 nets to P1
swapped 485 A and B at dip sw
added D19

rev A 5/10/2010

File	Size	Date
O4 Controller	Document Number <Doc>	Thursday, August 12, 2010