


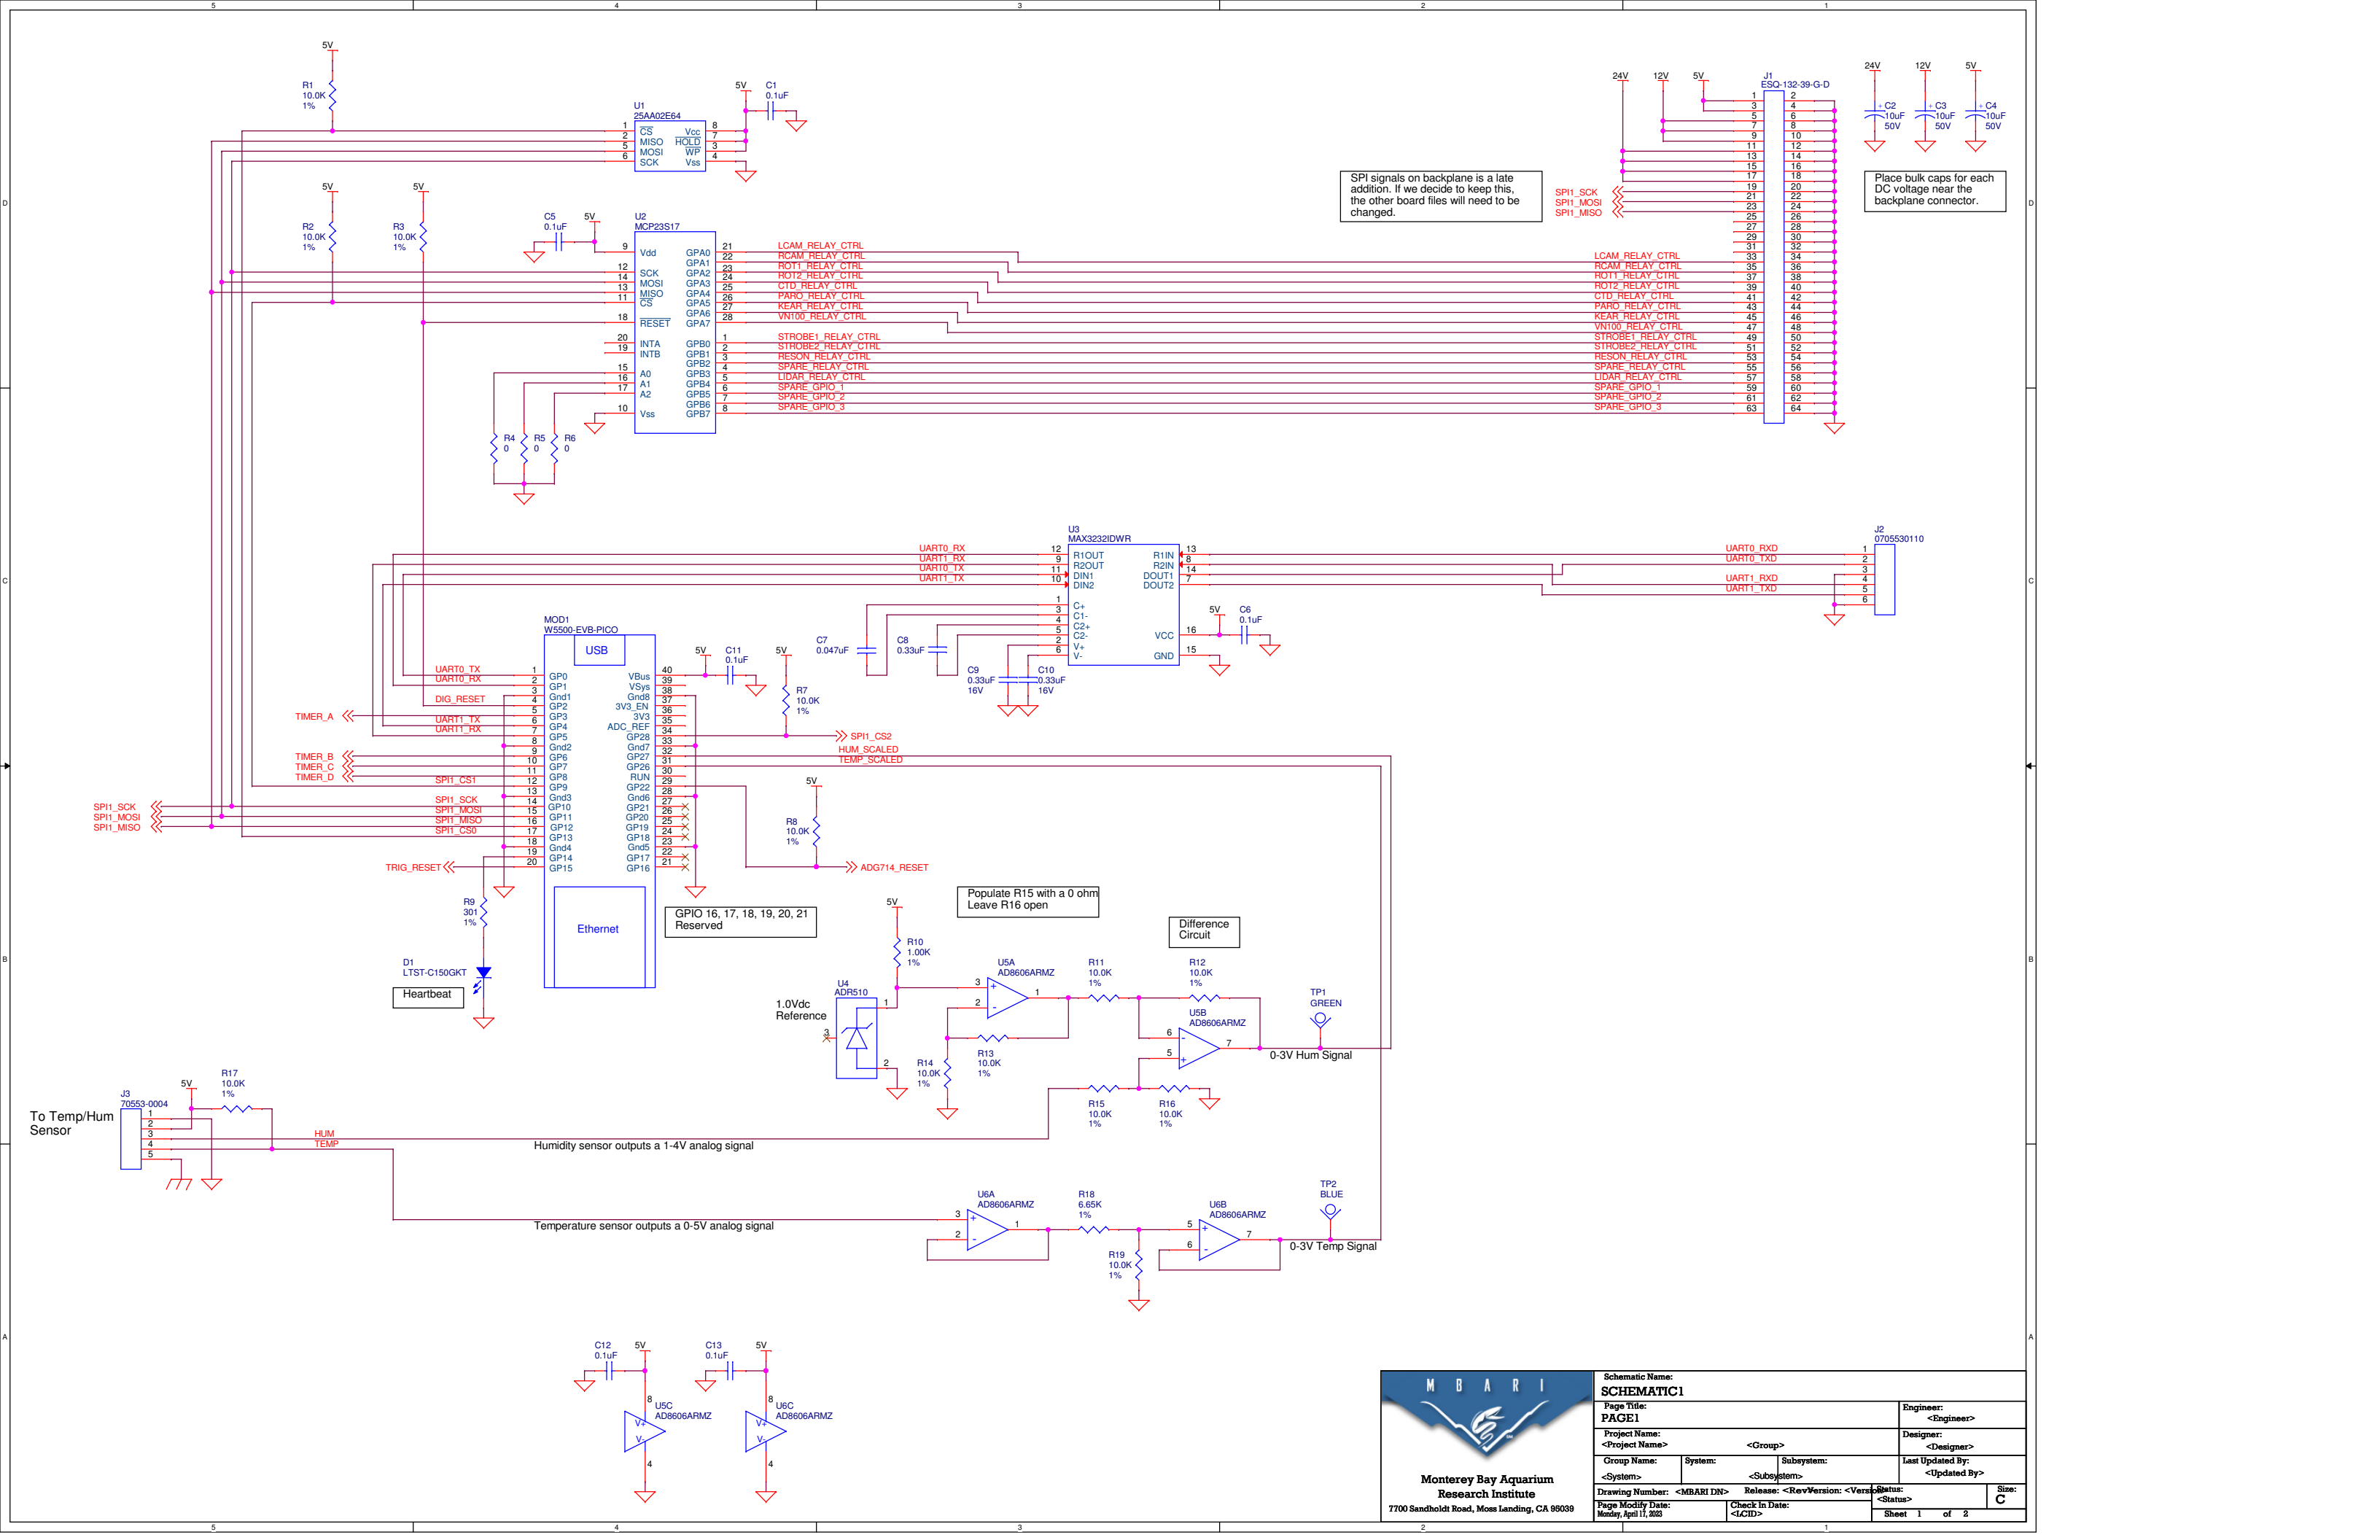

SPI signals on backplane is a late addition. If we decide to keep this, the other board files will need to be changed.

Place bulk caps for each DC voltage near the backplane connector.

Populate R15 with a 0 ohm
Leave R16 open

Difference Circuit

1.0Vdc Reference

Heartbeat

To Temp/Hum Sensor

Humidity sensor outputs a 1-4V analog signal

Temperature sensor outputs a 0-5V analog signal



Schematic Name: SCHEMATIC1			
Page Title: PAGE1		Engineer: <Engineer>	
Project Name: <Project Name>		Designer: <Designer>	
Group Name: <System>	System: <System>	Subsystem: <Subsystem>	Last Updated By: <Updated By>
Drawing Number: <MBARI DN>	Release: <Rev>	Version: <Version>	Status: <Status>
Page Modify Date: Monday, April 11, 2022	Check In Date: <LCID>	Sheet 1 of 2	