

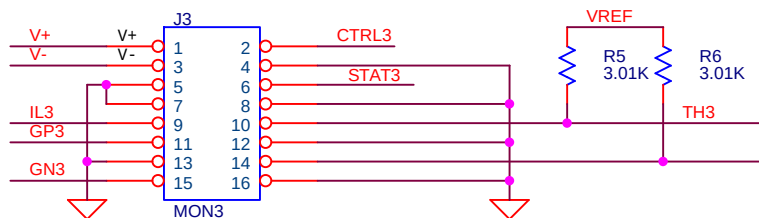
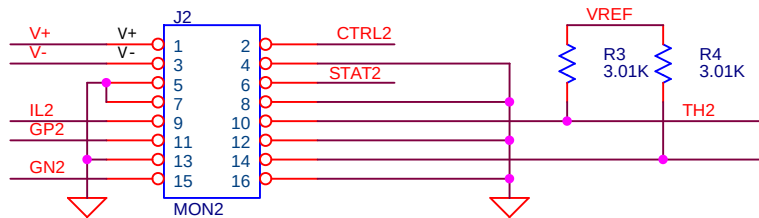



+12V

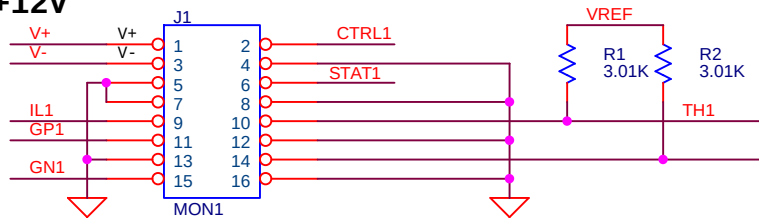


**POWER TO
CURRENT
SENSORS**

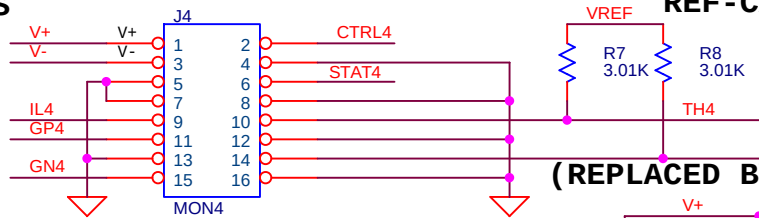

(REPLACED BY LEAK)

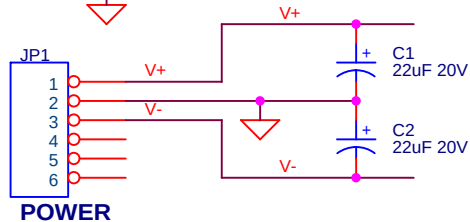


**POWER
SUPPLY
CONTROL**

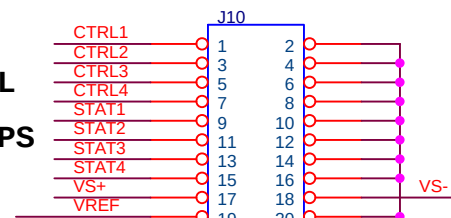


**RETURN PS
STATUS
BITS**

CURRENTS


**LEAK
(REPLACES TH4)**

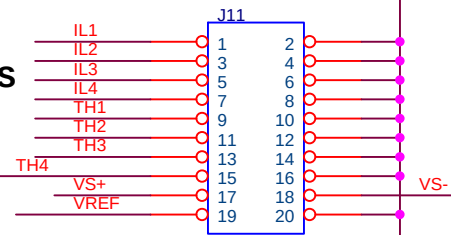

**GROUND
FAULTS**

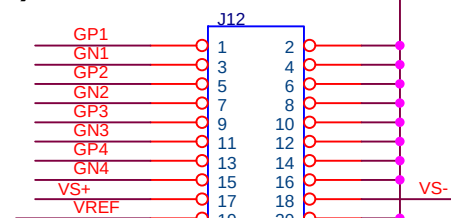

REF - CAL

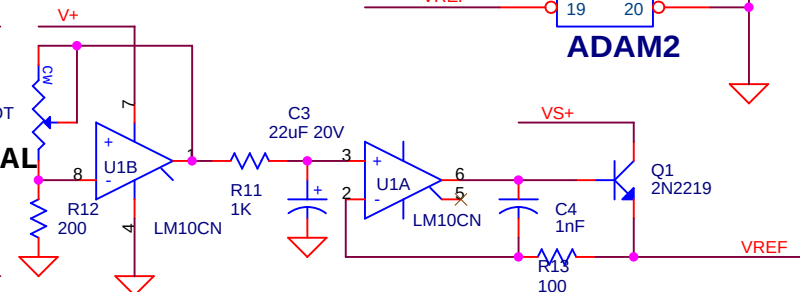

UNIVERSITY OF HAWAII SOEST

ENGINEERING SUPPORT FACILITY
2525 Correa Rd. Rm.153
Honolulu, HI 96822

Title

PATCH BOARD

Size
A

Document Number
1

Rev
A

Date: Monday, September 03, 2007

Sheet 1 of 1