



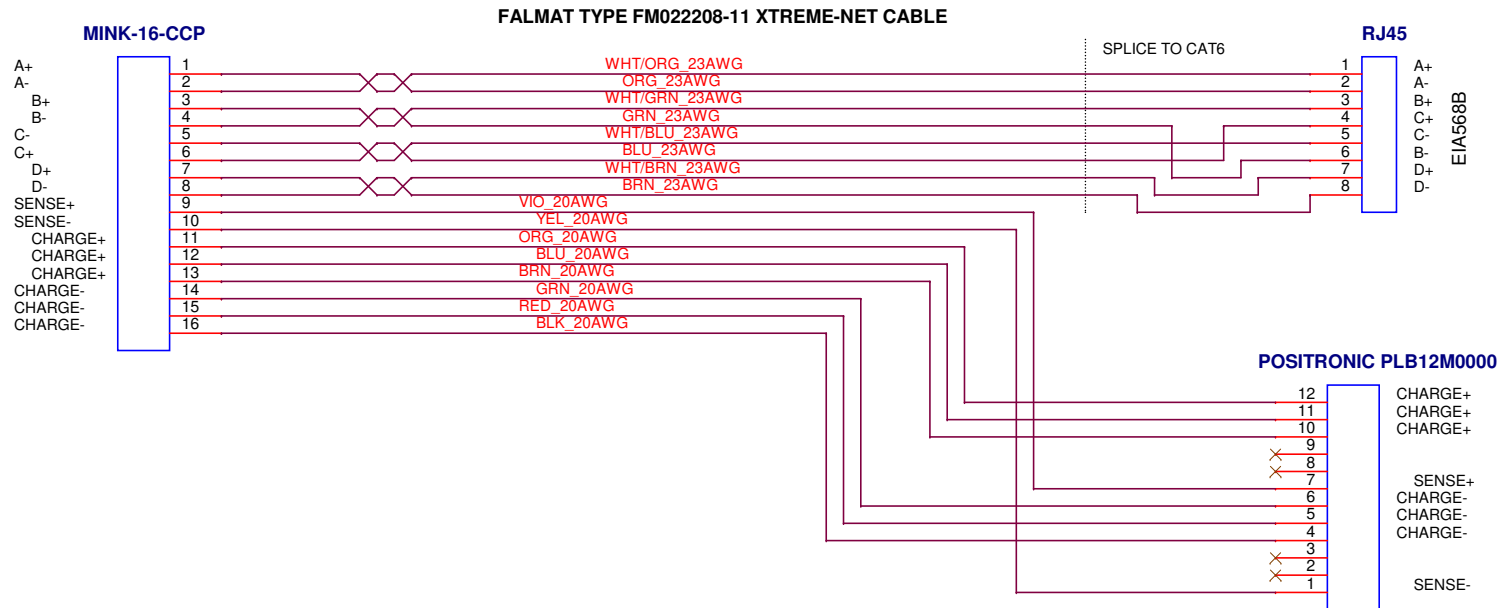

POSITRONIC PLB12M0000

MALE FACE VIEW
MALE CRIMP PINS MC116N (PINS 4-6 & 10-12)
MALE CRIMP PINS MC120N (PINS 1 & 7)



NOTES:

1. See drawing 100221308 for connection to TDK Lambda power supplies.
2. See drawing 100221277 for connection to bioacoustics sphere through whip assembly.
3. Length overall not to exceed 50-feet on Falmat Type FM022208-11 Xtreme-Net Cable
4. Splice ethernet wiring to 3-feet of CAT-6 cable.
5. Wrap label cable jacket at both ends "BIOACOUSTICS CHARGE".



Monterey Bay Aquarium Research Institute
7700 Sandholdt Road, Moss Landing, CA 95039

Engineer		Size		Document Number	
A		A		10022127 Rev 2	
Designer		Date:		Monday, July 22, 2019	
EIM		EIM		Sheet 8 of 25	

Title		Project	
Charge & Download Tether		901807	
Part Number		Rev	
CHG_DL_TETHER		2.1	
Project File		Rev	
dwr ad bioacoustics.dsn		2.1	