



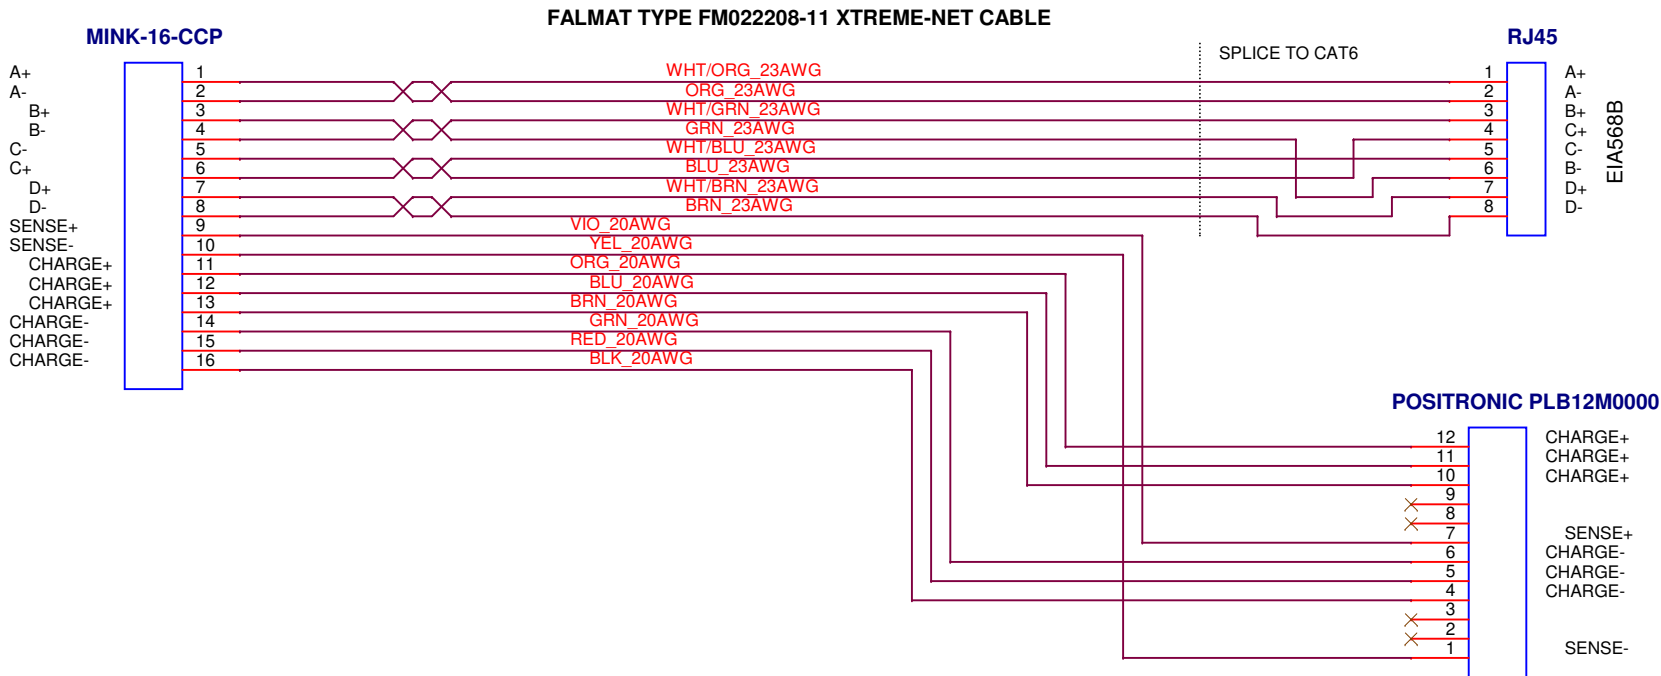

POSITRONIC PLB12M0000

MALE FACE VIEW
 MALE CRIMP PINS MC116N (PINS 4-6 & 10-12)
 MALE CRIMP PINS MC120N (PINS 1 & 7)



NOTES:

1. See drawing 100221308 for connection to TDK Lambda power supplies.
2. See drawing 100221277 for connection to bioacoustics sphere through whip assembly.
3. Length overall not to exceed 50-feet on Falmat Type FM022208-11 Xtreme-Net Cable
4. Splice ethernet wiring to 3-feet of CAT-6 cable.
5. Wrap label cable jacket at both ends "BIOACOUSTICS CHARGE".



Monterey Bay Aquarium Research Institute
 7700 Sandholdt Road, Moss Landing, CA 95039

Engineer		Size A	Document Number 100221278.2	Title CHG & Download Tether		Project 901807	
ETM	Designer			Part Number CHG_DL_TETHER		Project File doradobioacoustics.dsn	
ETM	Date: Monday, July 22, 2019		Sheet 8 of 25		Rev 2.1		