


REAR PANEL

FRONT PANEL

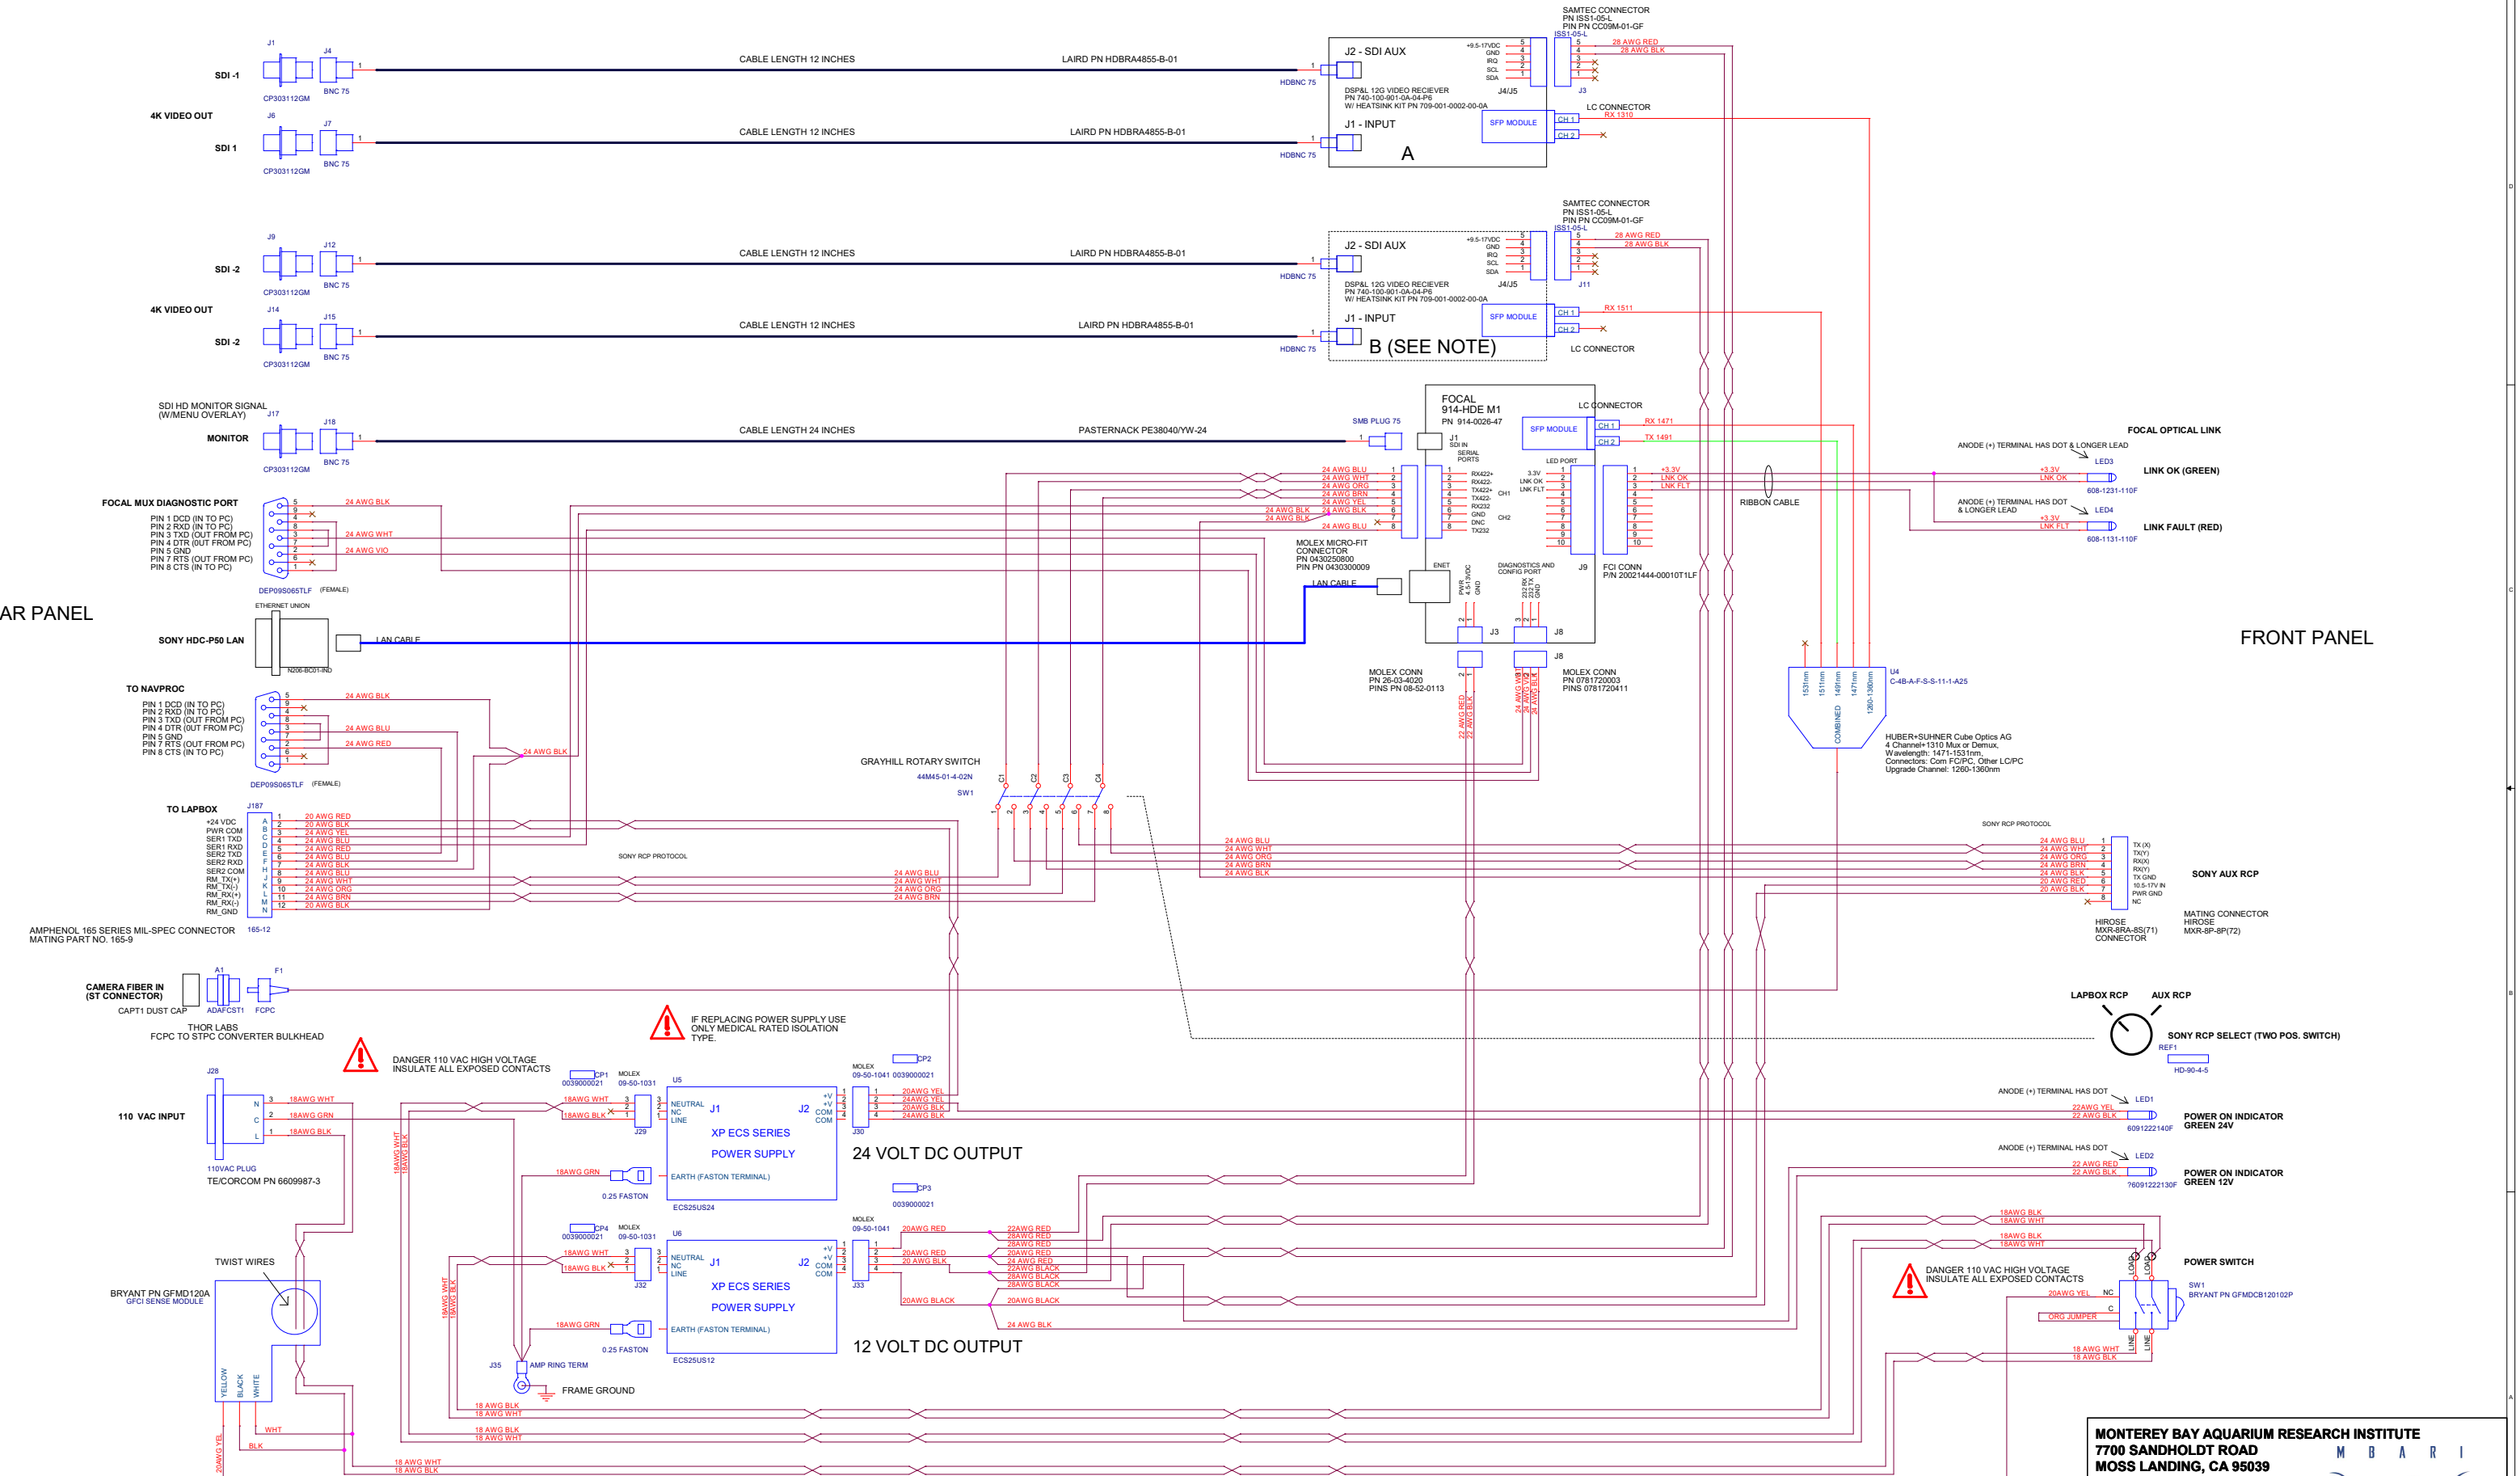

IF REPLACING POWER SUPPLY USE ONLY MEDICAL RATED ISOLATION TYPE.

⚠ DANGER 110 VAC HIGH VOLTAGE
INSULATE ALL EXPOSED CONTACTS

⚠ DANGER 110 VAC HIGH VOLTAGE
INSULATE ALL EXPOSED CONTACTS

NOTES:
1. USE HAMMOND PN RM2U1913VBK? RACK BOX (2U).
2. MECHANICALLY CONNECT ALL WIRE JUNCTIONS BEFORE SOLDERING AND INSULATE WITH 2 LAYERS OF HEATSHRINK TUBING.
3. HEATSHRINK INSULATE ALL EXPOSED 110VAC WIRING CONNECTIONS.
4. DEEPESEA 'B' MEDIA CONVERTER IS OPTIONAL AND IS NEEDED FOR SOME CAMERA MODES SUCH AS HIGH FRAME RATE. CAMERA FIRMWARE LICENSE MUST BE UPGRADED TO ACCESS THESE ADDITIONAL FEATURES.

REVISION HISTORY:
03-MAR-2021 REV. A First release. mrc
23-APR-2021 REV. B Added GFCL. mrc

PROJECT # 902001

MONTEREY BAY AQUARIUM RESEARCH INSTITUTE
7700 SANDHOLDT ROAD
MOSS LANDING, CA 95039
PHONE (831) 775-1700 www.mbari.org
COPYRIGHT 2021 MBARI
MAY NOT BE COPIED WITHOUT PERMISSION



4K ROV CAMERA RACK BOX WIRING

Size	Engineer: Mark Chaffey EMAIL: chma@mbari.org (831) 775-1708	Number	100221507-05-B-SCH	Rev	B
Date	Tuesday, December 07, 2021	Filename	NA	Sheet	1 of 1