


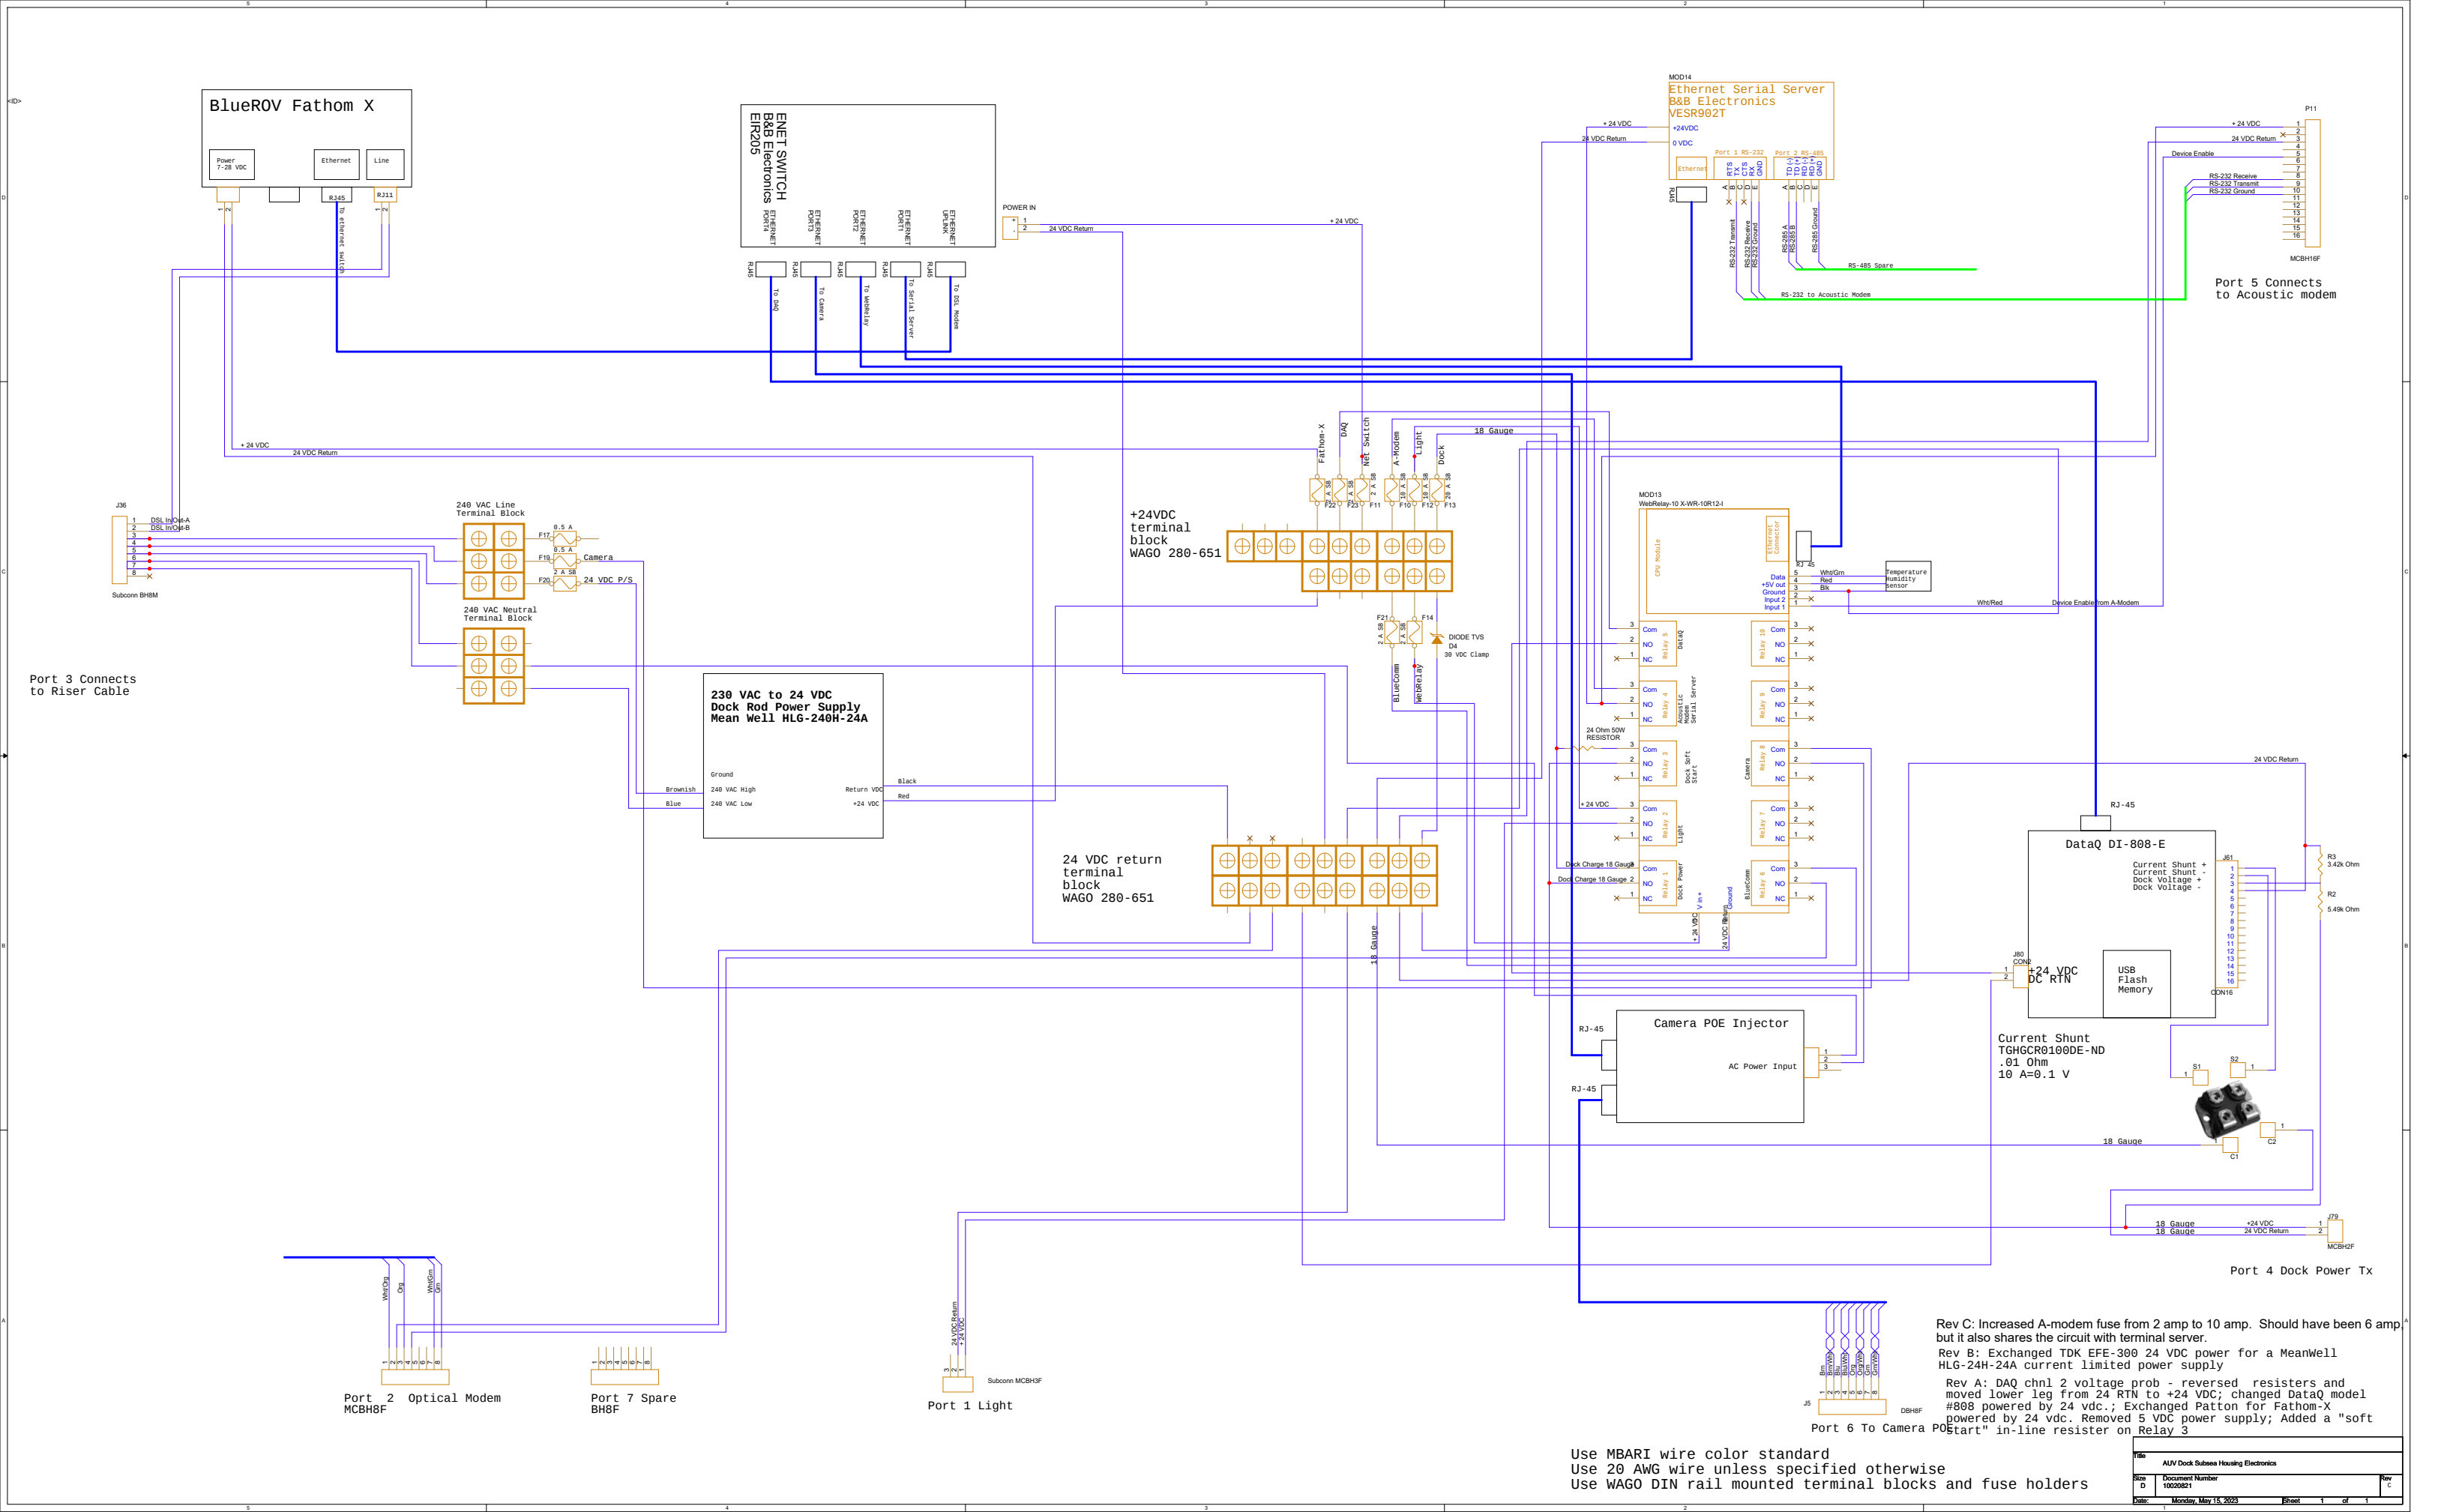

Use MBARI wire color standard
Use 20 AWG wire unless specified otherwise
Use WAGO DIN rail mounted terminal blocks and fuse holders

Rev C: Increased A-modem fuse from 2 amp to 10 amp. Should have been 6 amp but it also shares the circuit with terminal server.
Rev B: Exchanged TDK EFE-300 24 VDC power for a MeanWell HLG-24H-24A current limited power supply
Rev A: DAQ chnl 2 voltage prob - reversed resistors and moved lower leg from 24 RTN to +24 VDC; changed DataQ model #808 powered by 24 vdc.; Exchanged Patton for Fathom-X powered by 24 vdc. Removed 5 VDC power supply; Added a "soft start" in-line resistor on Relay 3

File		
AUV Dock Subsea Housing Electronics		
Size	Document Number	Rev
D	10020821	C
Date:	Monday, May 15, 2023	Sheet 1 of 1