


300 West Broad Street P.O. Box 250 Burlington, NJ 08016 USA Phone: 800-257-9537 Fax: 609-386-6739

Designed For: MONTEREY BAY AQUARIUM
 Equipment Type: AQUARIUM
 Covers A: 0 mm-Dia.
 Quote Number: 9533-MBARI
 Location: UNDER WATER
 Extension Req'd: 90 mm
 Customer Ref. Dwg. 0
 Operating Direction: VERTICAL
 Max Compr'd Lgt: 0 mm
 Max Temperature: 75 °F
 Minimum ID: 325 mm
 By: JM/JJ
 Date: 1/0/00
 Speed (in/min): 0.0

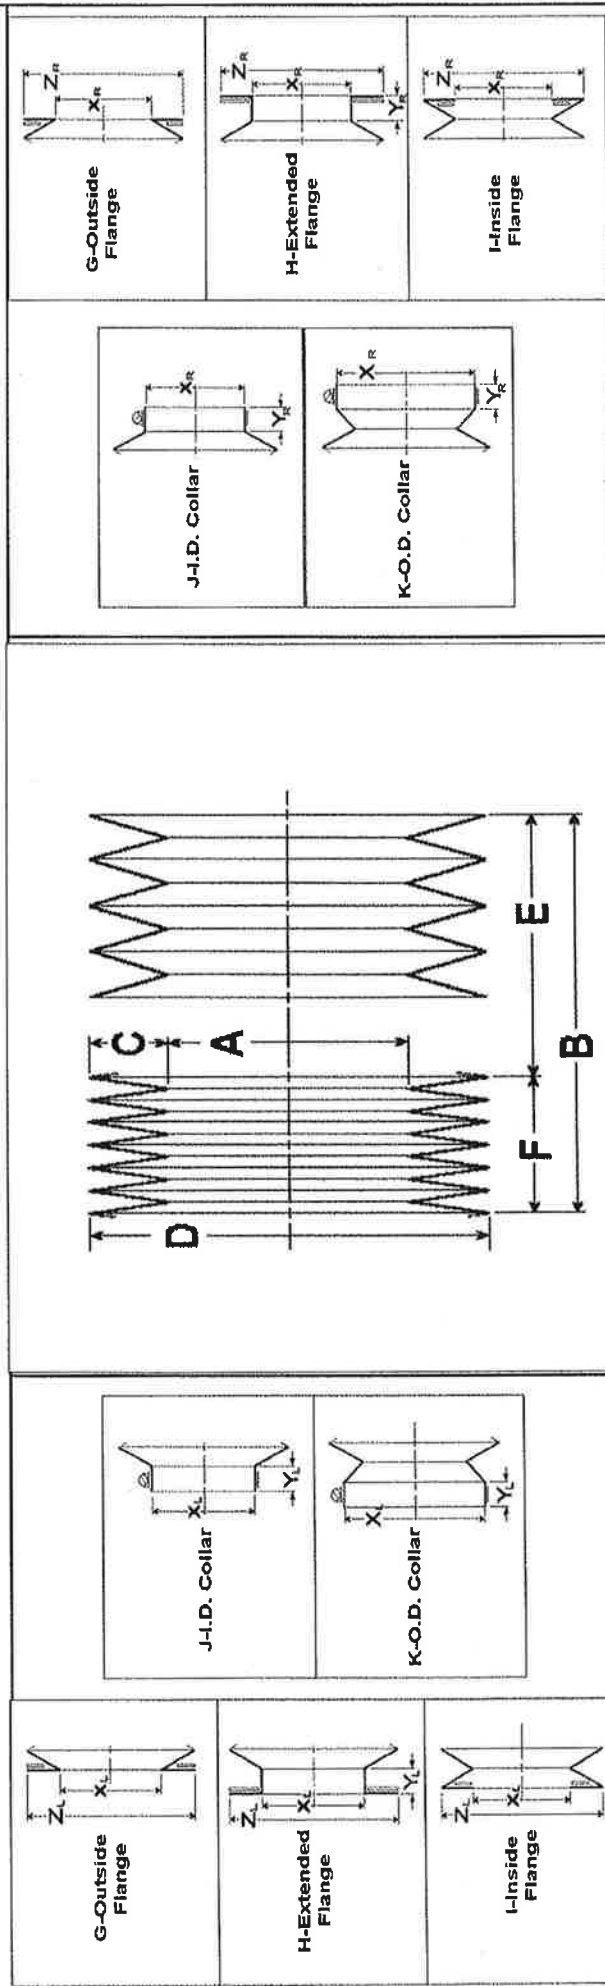

Left End Style		H-Ext'd Flg		Bellows Type		R.F. WELDED BELLOWS		Number of "V"s":		Right End Style		H-Ext'd Flg	
XL	YL	ZL		A	B	C	D	E	F	XR	YR	ZR	
Left End ID	Left End Lgt	Left End OD		Inside Dia.	Extended Lgt	"V" Depth	Outside Dia	Stroke	Compr'd Lgt	Right End ID	Right End Lgt	Left End OD	
240.0mm	6mm	300mm		240.0mm	90 mm	30 mm	300 mm	80 mm	10 mm	240.0mm	6mm	300mm	
9.449 in	0.236 in	11.811 in		9.449 in	3.543 in	1.181 in	11.81 in	3.15 in	0.394 in	9.449 in	0.236 in	11.811 in	
Material: URETHANE FILM 0.040 in thk													
16 - 7.200 mm Dia Holes 270.000 mm Dia Bolt Circle													

Internal/External Supports		Special Instructions:		Extension Controls	
Supt Type	NONE	1 BELLOWS MUST BE VENTED TO ATMOSPHERE TO ALLOW ENTRAPPED AIR TO ESCAPE. 2		Control Style # of Controls	NONE 0
Customer Approval By: <i>[Signature]</i> Date: <i>Aug 20 2013</i>		Std Tolerances Dimensions ± 2 mm Angles ± 1°		Vents Vent type # Vents	NONE 0

THE INFORMATION CONTAINED, OR PART DESCRIBED IN THIS DOCUMENT OR DRAWING REPRESENTS CENTRYCO'S INTERPRETATION OF YOUR APPLICATION AND/OR DESIGN. AS SUCH, IT WILL BE USED IN THE MANUFACTURING OF PRODUCT SPECIFICALLY FOR YOU.