




NOTES:  
1) Run individual wire pairs from +/- 24VDC Terminal Blocks to each 24VDC module  
2) Add Terminal Blocks as necessary

REVISION HISTORY  
May 1, 2010 Initial Release  
June 14, 2010 Add final power distribution details  
June 22, 2010 Fix battery Terminal Block wiring  
July 8, 2010 Change Load Cell Signal conditioner to voltage input

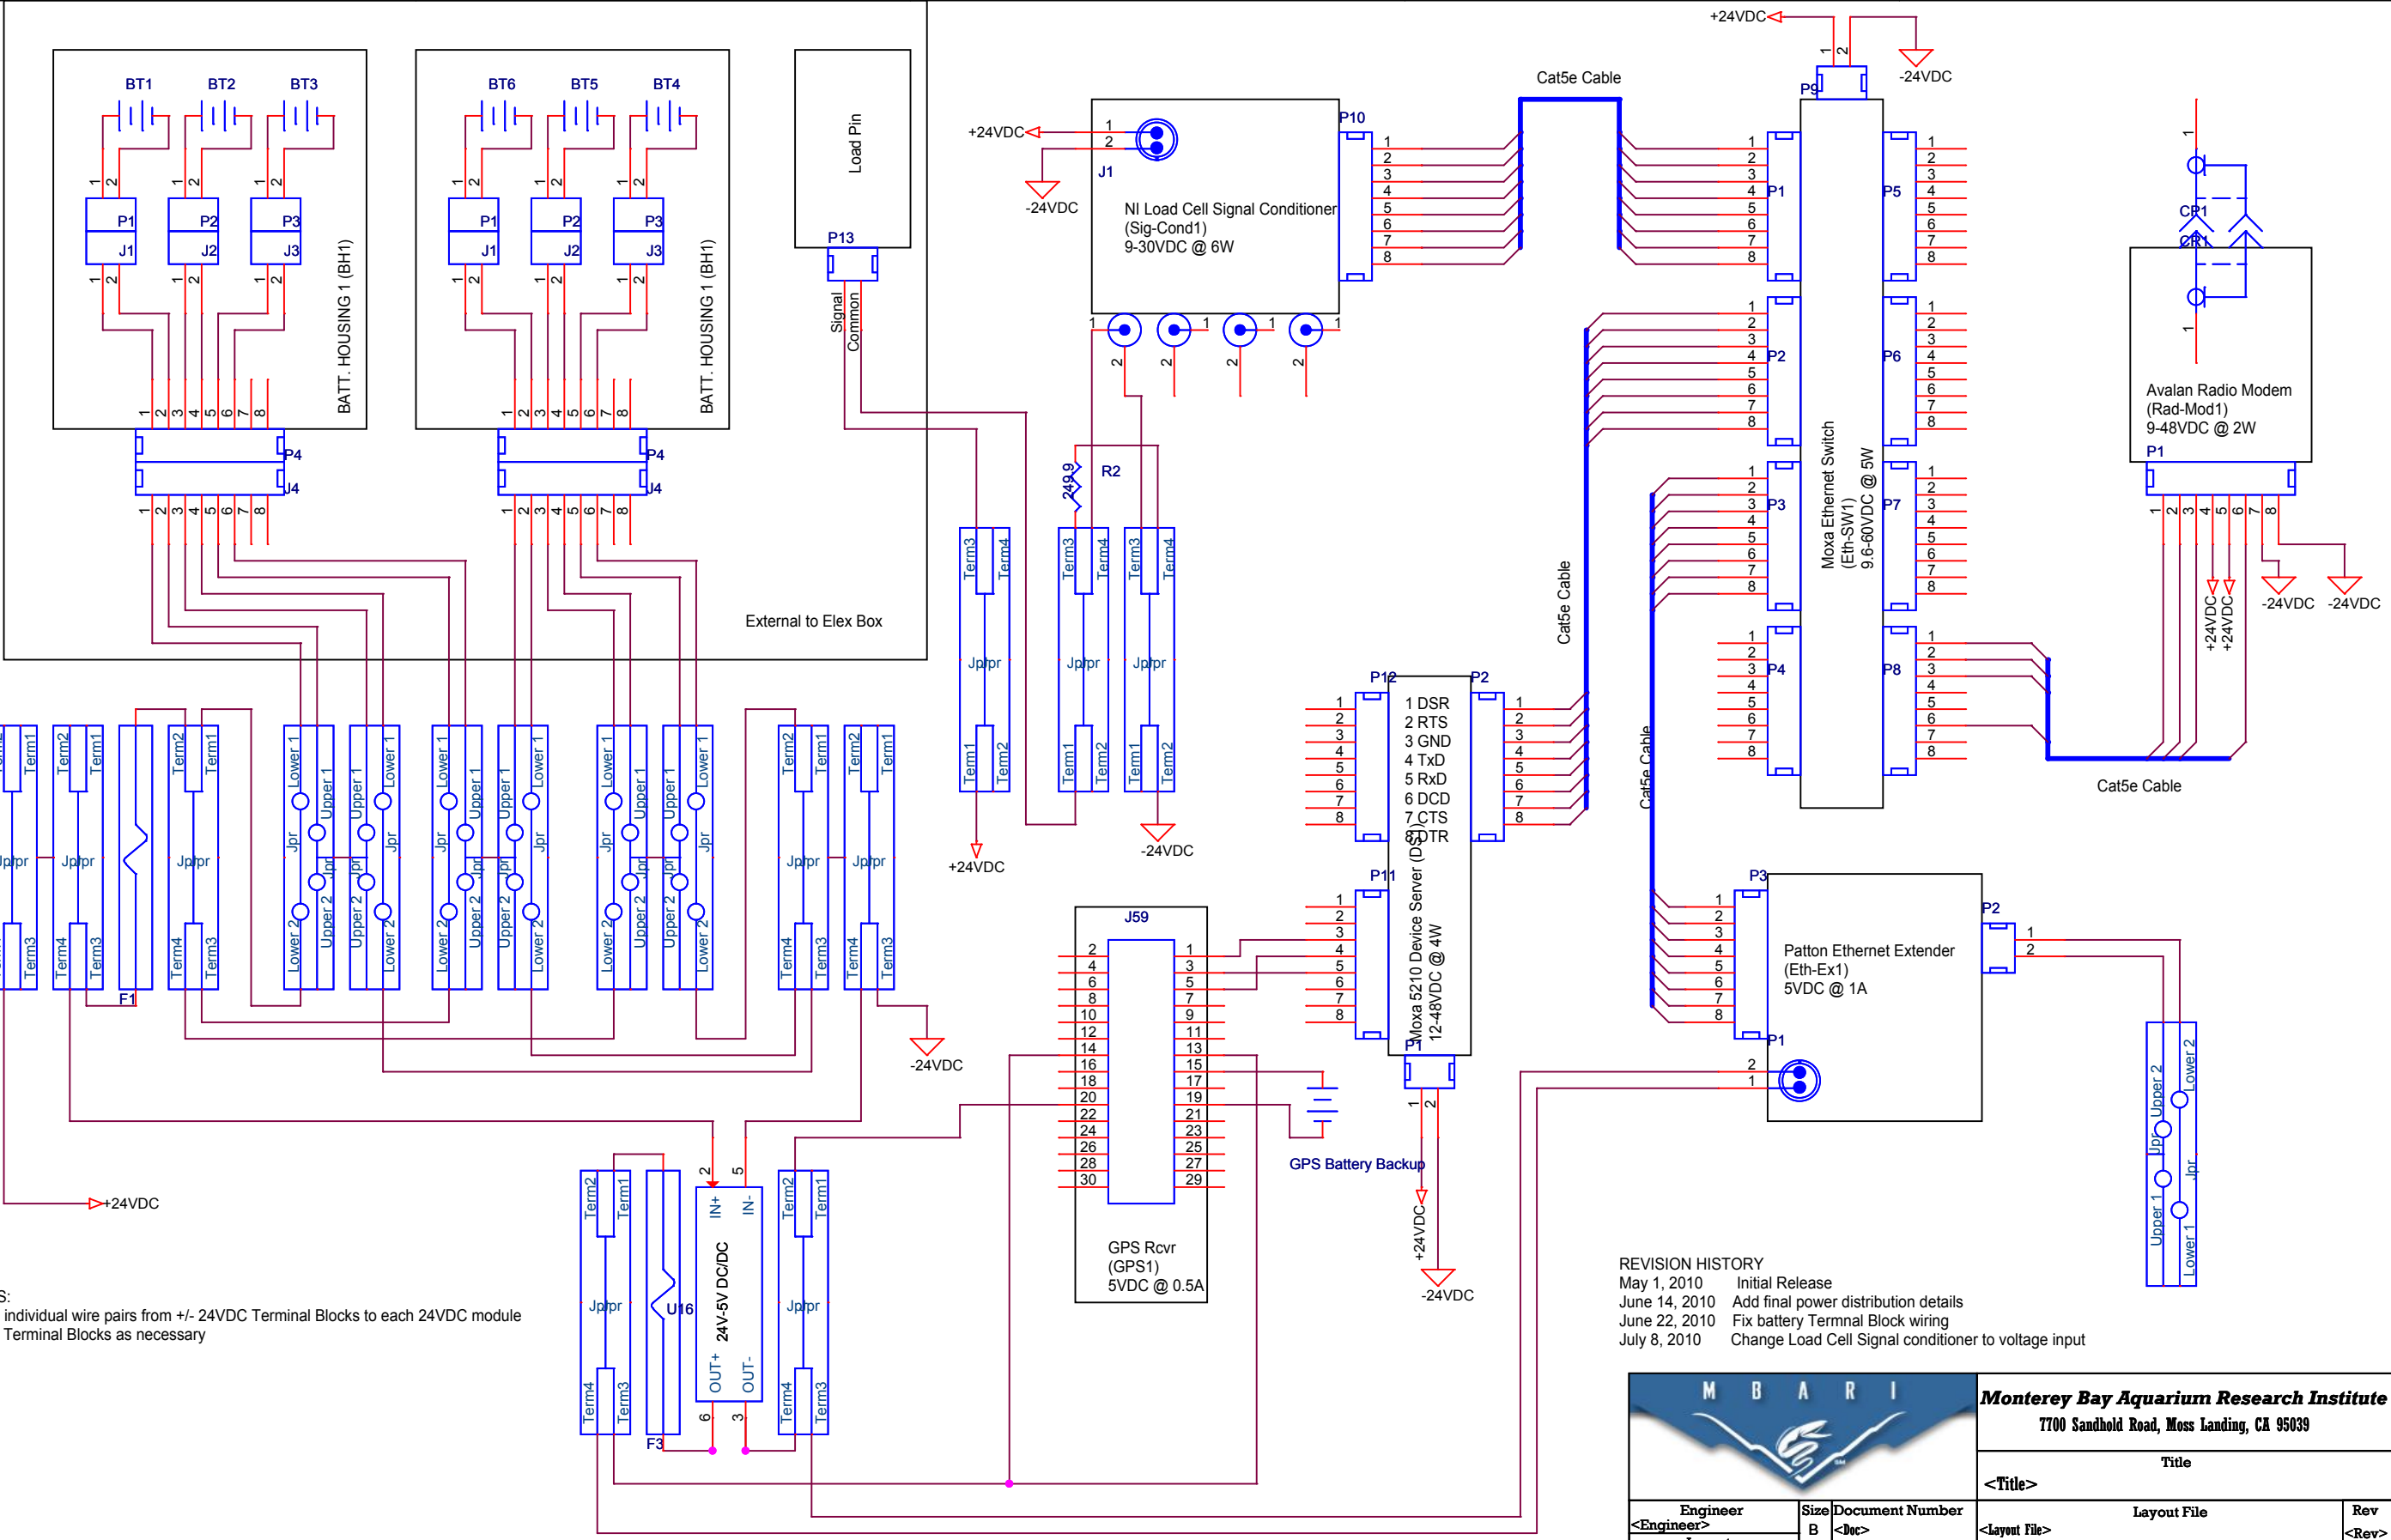

**Monterey Bay Aquarium Research Institute**  
7700 Sandhold Road, Moss Landing, CA 95039

|            |                              |                 |       |
|------------|------------------------------|-----------------|-------|
| Title      |                              |                 |       |
| <Title>    |                              |                 |       |
| Engineer   | Size                         | Document Number | Rev   |
| <Engineer> | B                            | <Doc>           | <Rev> |
| Layout     | Layout File                  |                 |       |
| <Layout>   | Date: Monday, March 14, 2011 | Sheet 1 of 1    |       |